

CAE 331/513

Building Science

Fall 2017



October 12, 2017

Psychrometric processes (part 2)

Built
Environment
Research

@ IIT



*Advancing energy, environmental, and
sustainability research within the built environment*

www.built-envi.com

Twitter: [@built_envi](https://twitter.com/built_envi)

Dr. Brent Stephens, Ph.D.

Civil, Architectural and Environmental Engineering


Illinois Institute of Technology

brent@iit.edu

PSYCHROMETRIC PROCESSES

Using energy and mass balance equations

Energy/mass balances for psychrometric processes

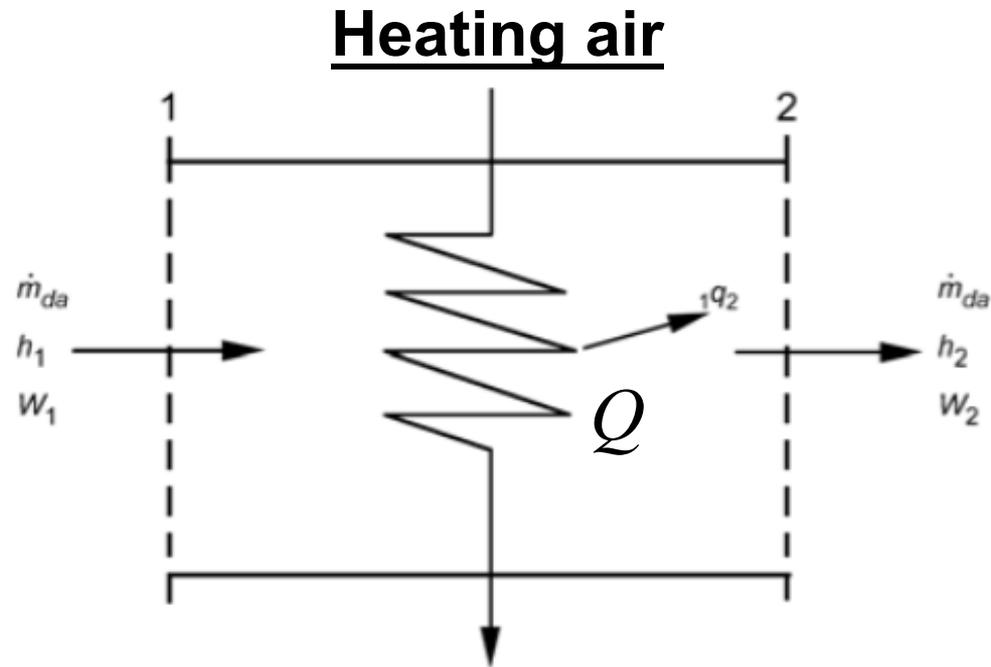


Energy balance: $\dot{m}_{da,1} h_1 + Q_{1 \rightarrow 2} = \dot{m}_{da,2} h_2$

Mass balance on air: $\dot{m}_{da,1} = \dot{m}_{da,2} = \dot{m}_{da}$

Mass balance on water vapor: $\dot{m}_{da,1} W_1 = \dot{m}_{da,2} W_2$

Therefore: $Q_{1 \rightarrow 2} = \dot{m}_{da} (h_2 - h_1)$

Energy/mass balances for psychrometric processes

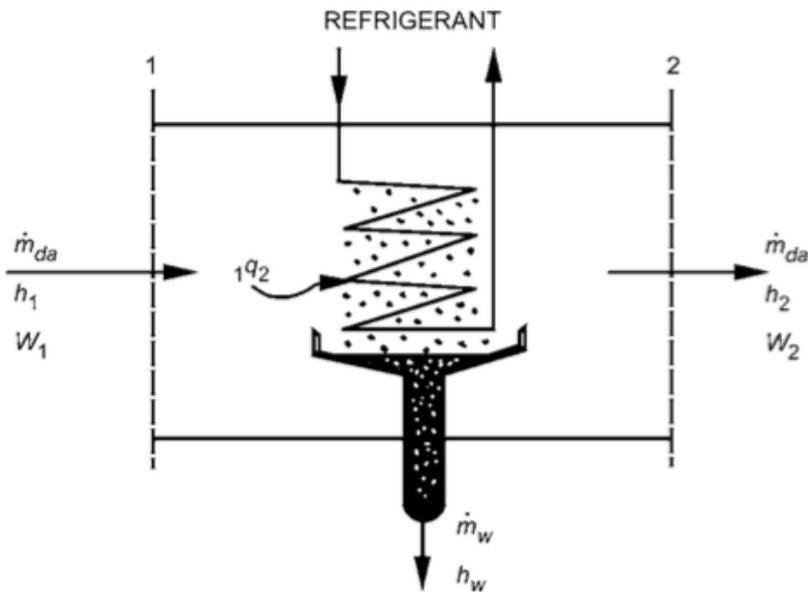

Cooling and dehumidifying

*Note that $h_w = h_g$ for steam/vapor and $h_w = h_f$ for water

Energy balance: $\dot{m}_{da,1} h_1 + Q_{1 \rightarrow 2} = \dot{m}_{da,2} h_2 + \dot{m}_w h_{w,2}$

Mass balance on air: $\dot{m}_{da,1} = \dot{m}_{da,2} = \dot{m}_{da}$

Mass balance on water vapor: $\dot{m}_{da,1} W_1 = \dot{m}_{da,2} W_2 + \dot{m}_w$

Therefore: $\dot{m}_w = \dot{m}_{da} (W_1 - W_2)$


Note: error in sign last lecture PPT

And: $Q_{1 \rightarrow 2} = \dot{m}_{da} [(h_2 - h_1) - (W_2 - W_1) h_{w,2}]$

(Q is negative for cooling)

Energy/mass balances for psychrometric processes

Humidifying

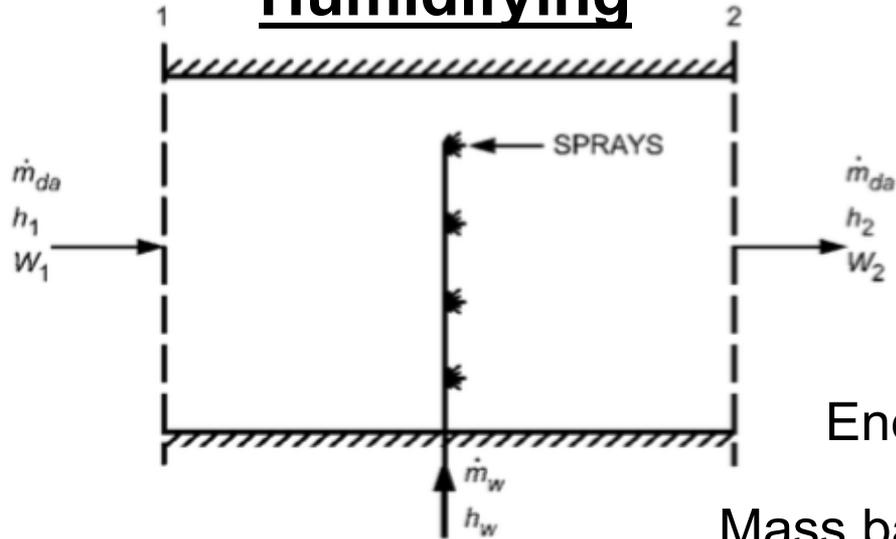

Energy balance:

$$\dot{m}_{da,1} h_1 + \dot{m}_w h_w = \dot{m}_{da,2} h_2$$

Mass balance on air:

$$\dot{m}_{da,1} = \dot{m}_{da,2} = \dot{m}_{da}$$

Mass balance on water vapor:

$$\dot{m}_{da,1} W_1 + \dot{m}_w = \dot{m}_{da,2} W_2$$

Therefore:

$$\dot{m}_w = \dot{m}_{da} (W_2 - W_1)$$

And:

$$\dot{m}_w h_w = \dot{m}_{da} (h_2 - h_1)$$


And:

$$\frac{h_2 - h_1}{W_2 - W_1} = \frac{\Delta h}{\Delta W} = h_w$$

*Note that $h_w = h_g$ for steam/vapor and $h_w = h_f$ for water

Energy/mass balances for psychrometric processes

- **Mixing**: Often in HVAC systems we mix airstreams adiabatically
 - **Adiabatically** = Without the addition or extraction of heat
 - e.g. outdoor air mixed with a portion of return/recirculated air

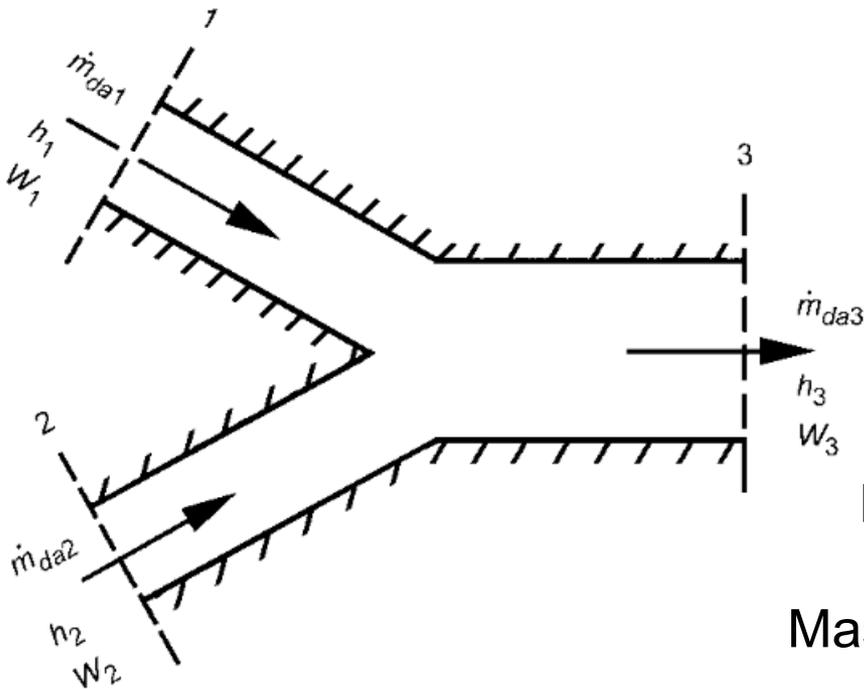

$$\text{Energy: } \dot{m}_{da,1} h_1 + \dot{m}_{da,2} h_2 = \dot{m}_{da,3} h_3$$

$$\text{Mass (air): } \dot{m}_{da,1} + \dot{m}_{da,2} = \dot{m}_{da,3}$$

$$\text{Mass (water): } \dot{m}_{da,1} W_1 + \dot{m}_{da,2} W_2 = \dot{m}_{da,3} W_3$$

Energy/mass balances for psychrometric processes


- **Mixing:** For most parameters, the outlet conditions end up being the weighted averages of the input conditions based on their mass flow rates

- Dry bulb temperature
- Humidity ratio
- Enthalpy
- (not RH!)

$$T_3 = \frac{\dot{m}_{da1}T_1 + \dot{m}_{da2}T_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$


$$W_3 = \frac{\dot{m}_{da1}W_1 + \dot{m}_{da2}W_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$

$$h_3 = \frac{\dot{m}_{da1}h_1 + \dot{m}_{da2}h_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$

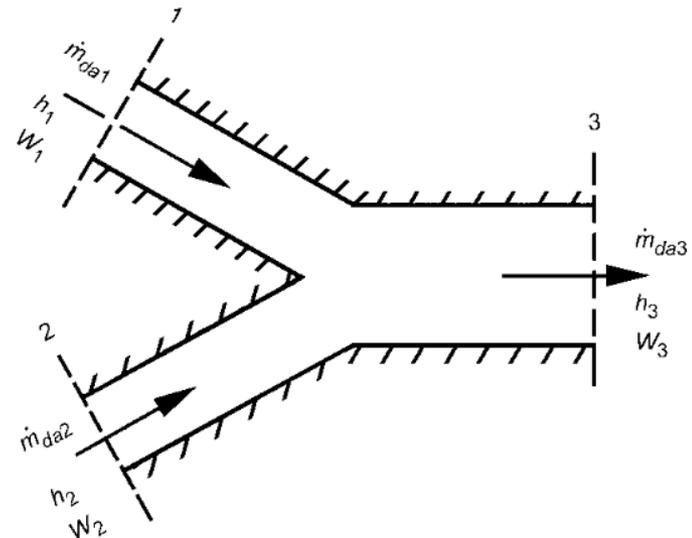

Energy/mass balances for psychrometric processes

Space heat and moisture gains

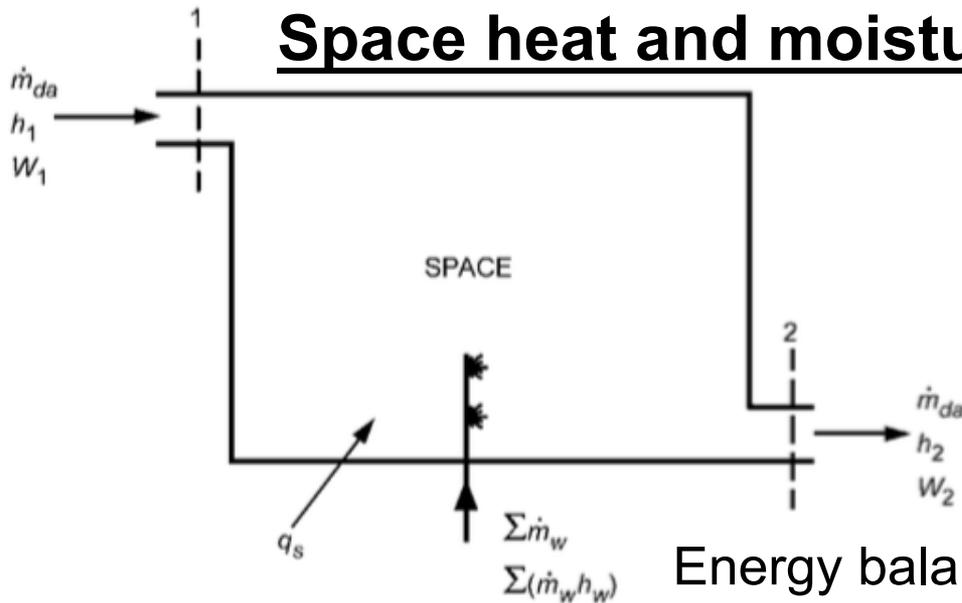

Energy balance: $\dot{m}_{da} h_1 + Q_{gains} + \sum \dot{m}_w h_w = \dot{m}_{da} h_2$

Mass balance on water vapor: $\dot{m}_{da} W_1 + \sum \dot{m}_w = \dot{m}_{da} W_2$

Therefore: $\sum \dot{m}_w = \dot{m}_{da} (W_2 - W_1)$

Therefore: $\sum \dot{m}_w h_w + Q_{gains} = \dot{m}_{da} (h_2 - h_1)$

*Note that $h_w = h_g$ for steam/vapor and $h_w = h_f$ for water



And: $\frac{\Delta h}{\Delta W} = \frac{\sum \dot{m}_w h_w + Q_{gains}}{\sum \dot{m}_w}$


PSYCHROMETRIC PROCESSES

Example problems


Example 1: Heating (IP)

- Moist air, saturated at 35°F, enters a heating coil at a rate of 20,000 CFM and air leaves the coil at 100°F
 - Find the required rate of heat addition

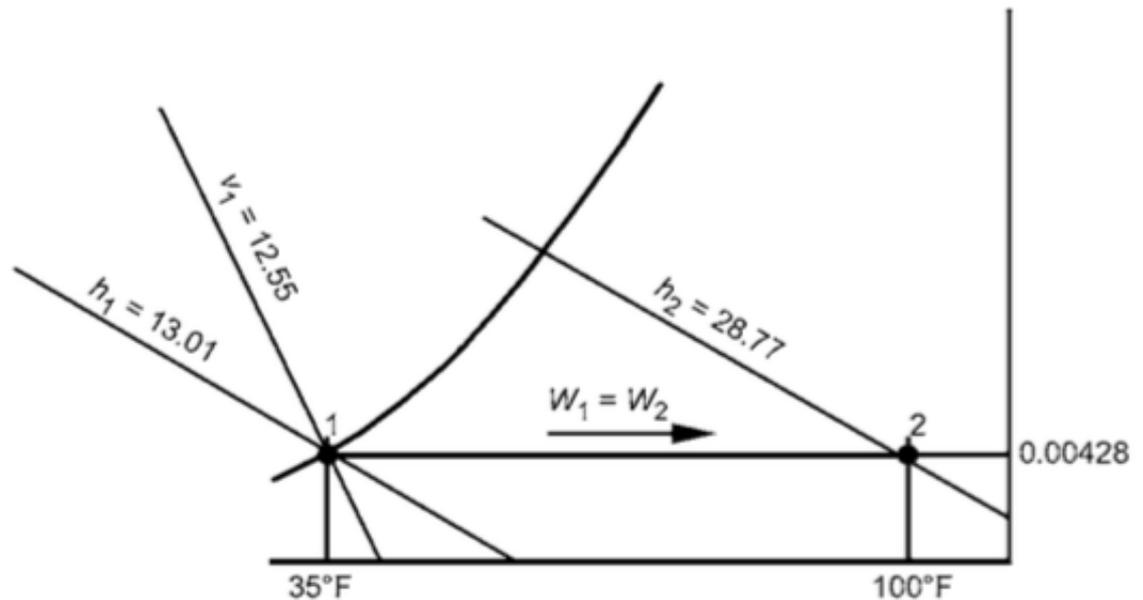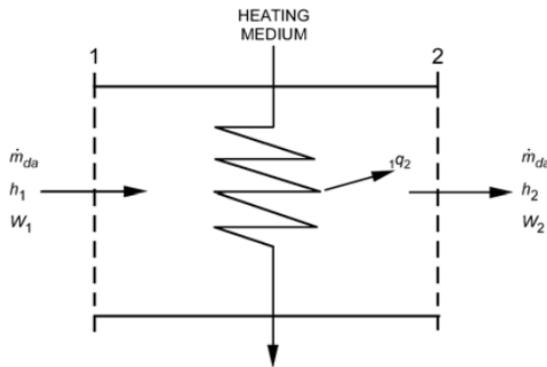

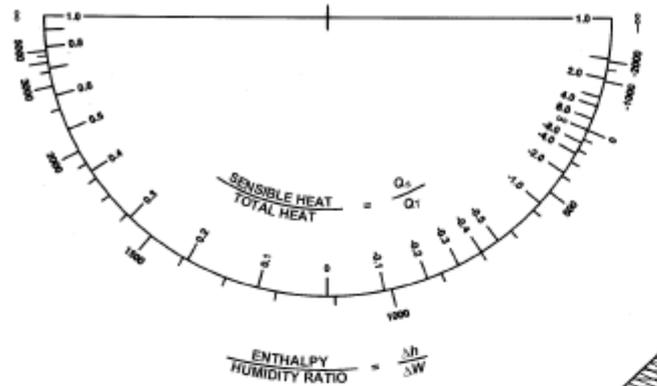

IP chart

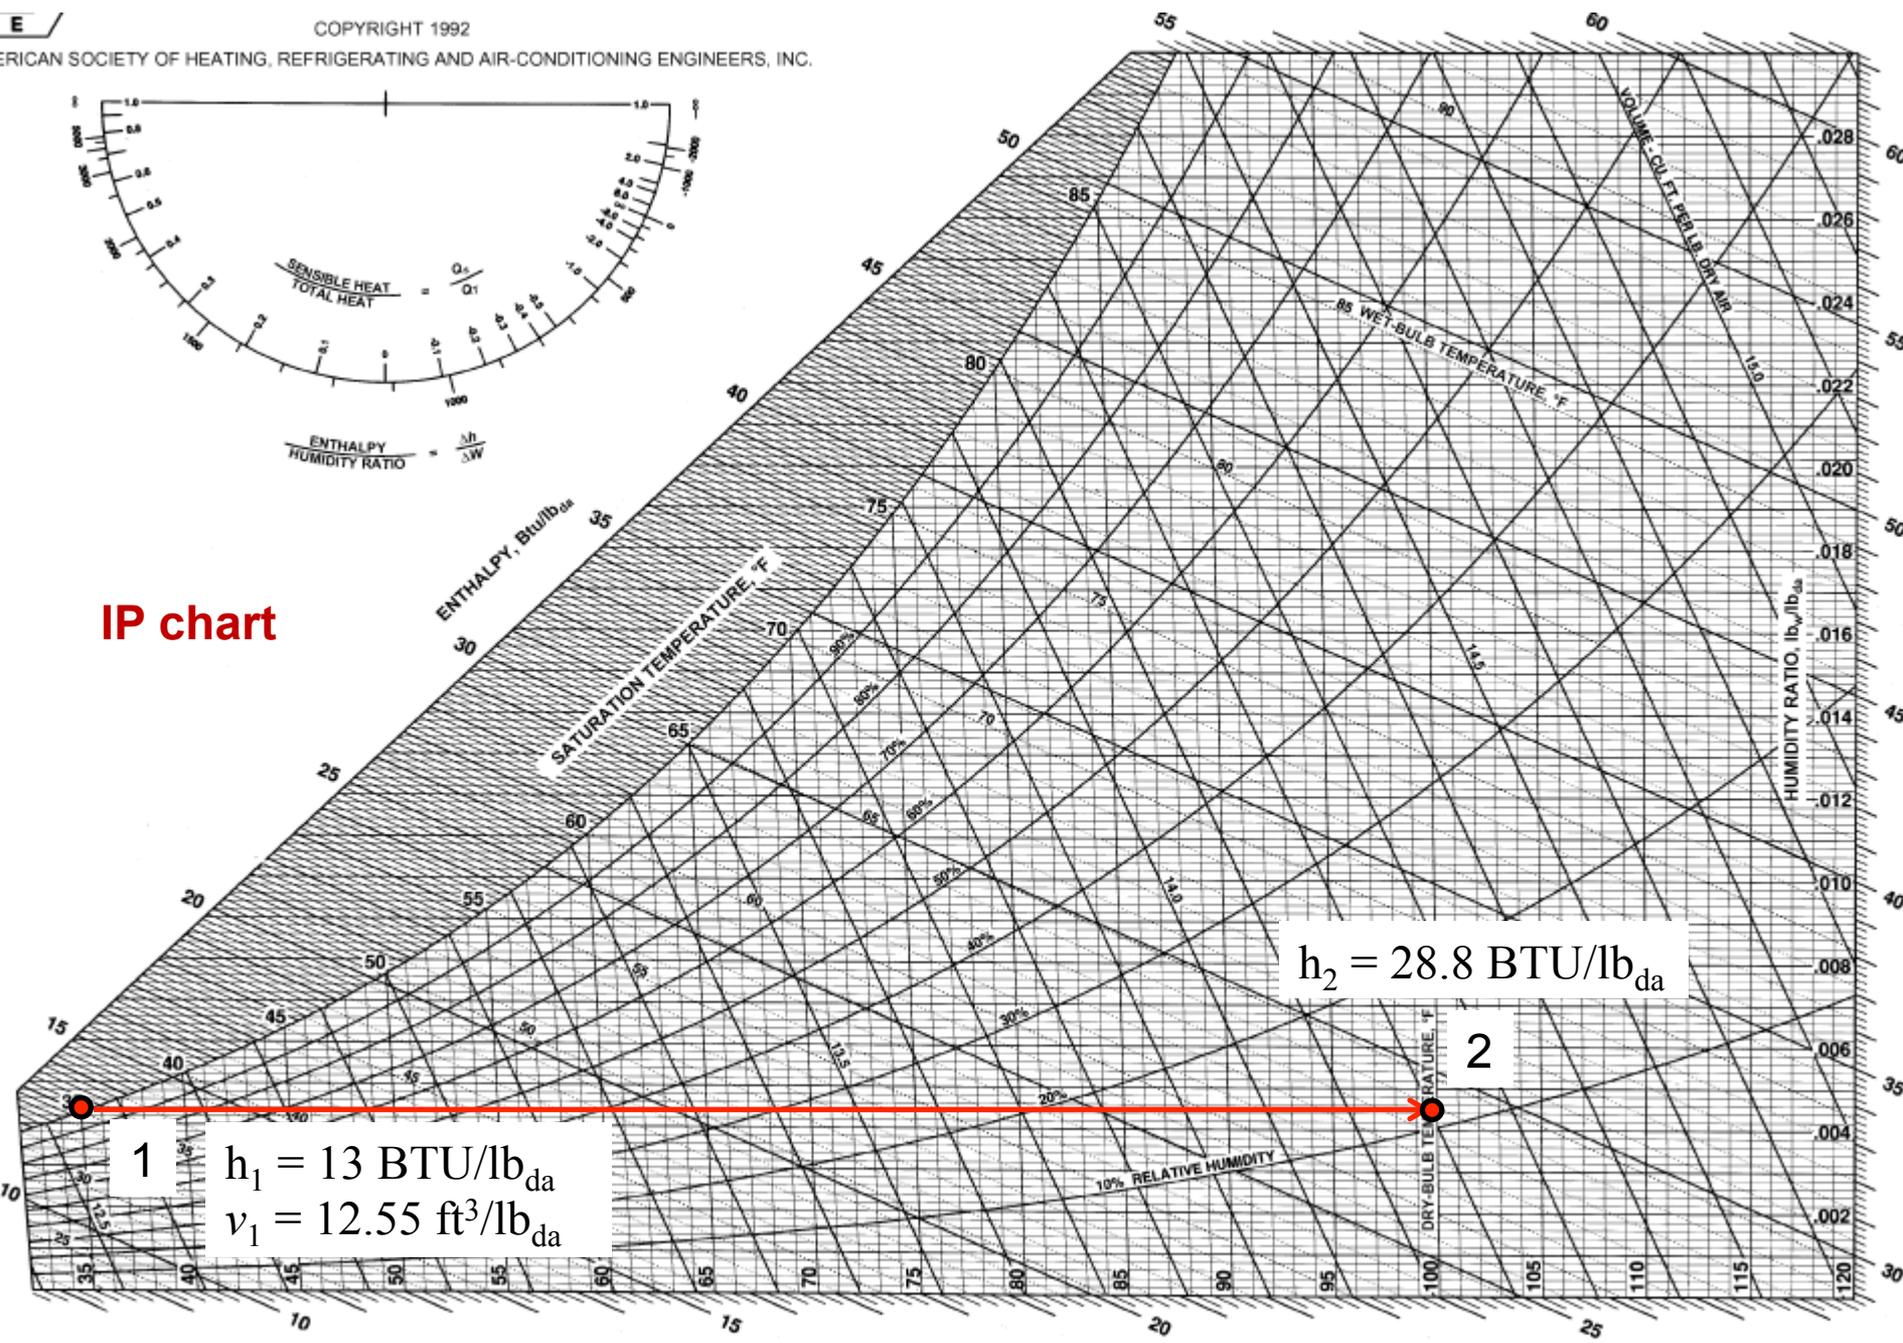



1 $h_1 = 13 \text{ BTU/lb}_{da}$
 $v_1 = 12.55 \text{ ft}^3/\text{lb}_{da}$


$h_2 = 28.8 \text{ BTU/lb}_{da}$

2


Example 2: Cooling and dehumidification (IP)

- Moist air at 85°F dry-bulb temperature and 50% RH enters a cooling coil at 10,000 CFM and is processed to final saturation conditions at 50°F
 - Find the tons of refrigeration required

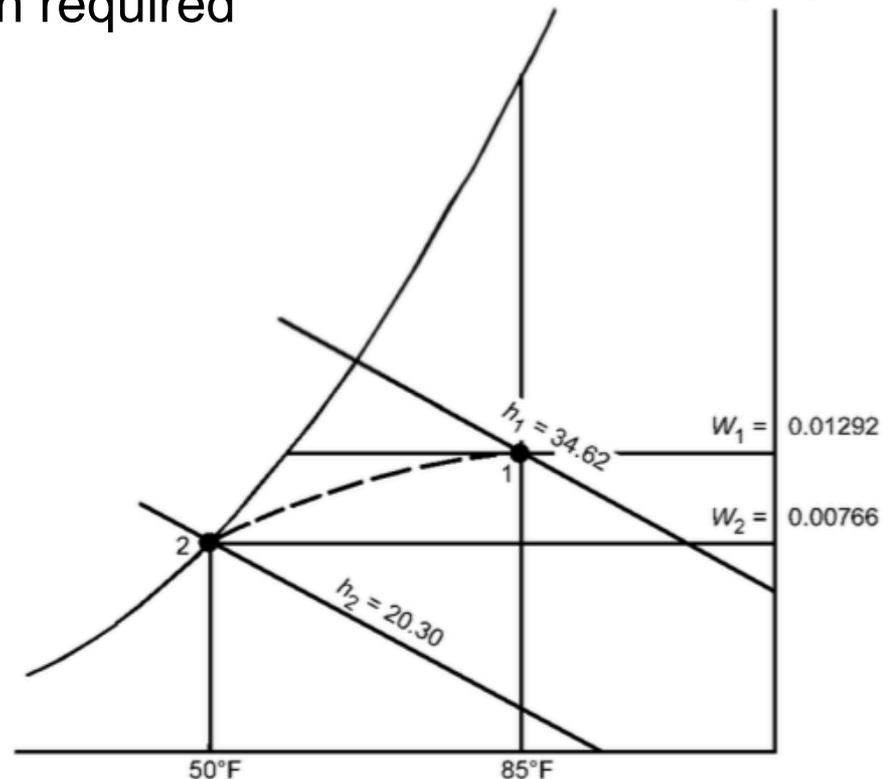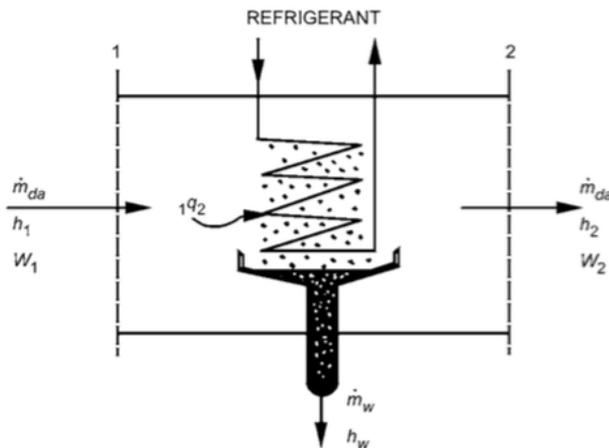

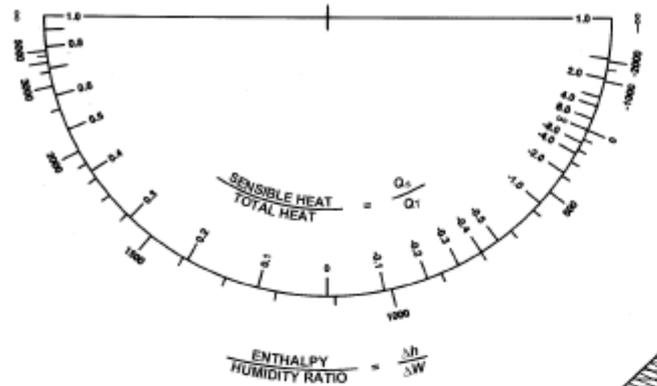

IP chart

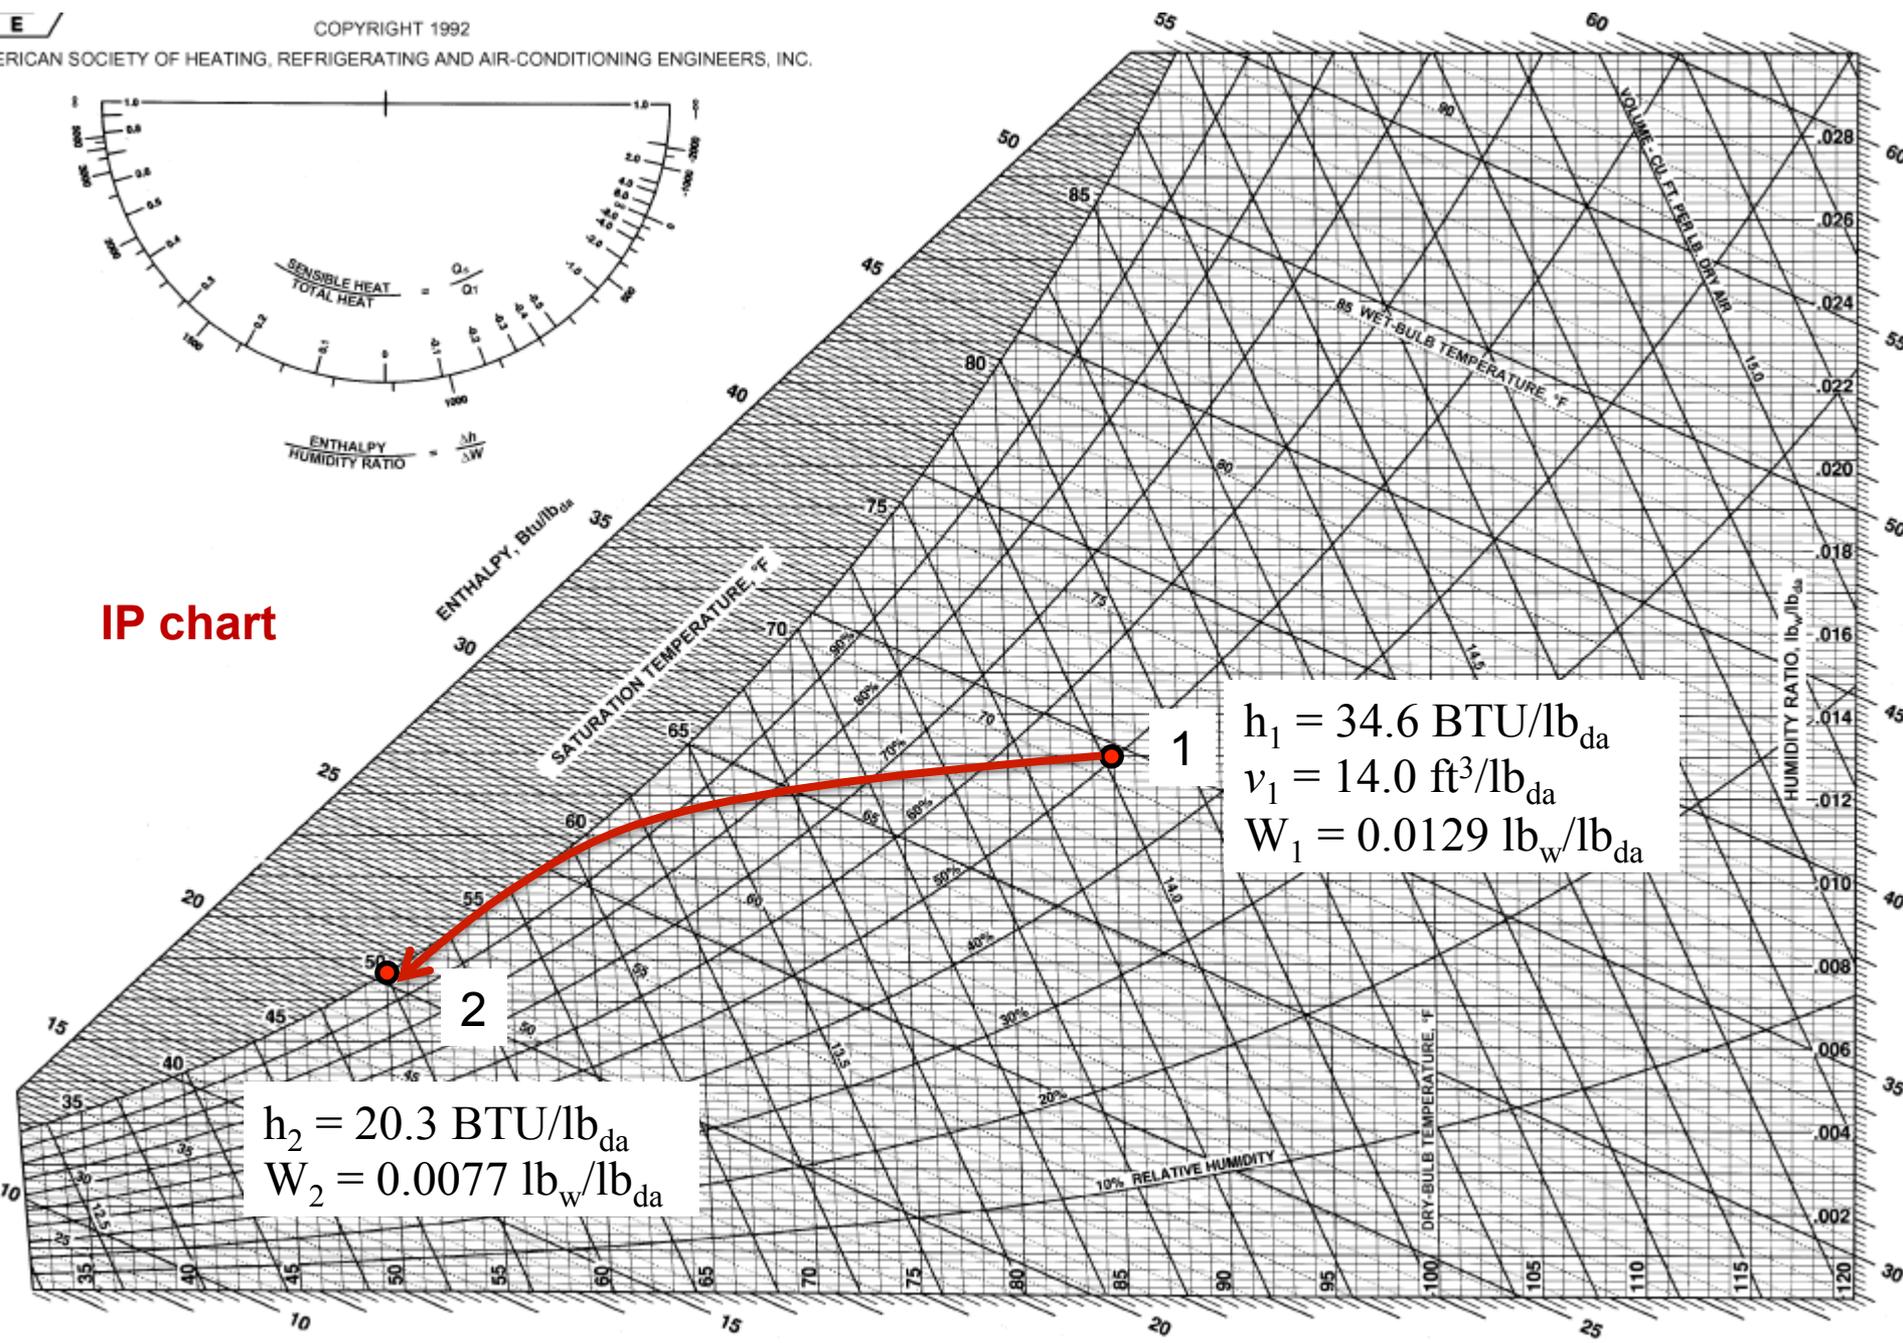



$h_2 = 20.3 \text{ BTU/lb}_{da}$
 $W_2 = 0.0077 \text{ lb}_w/\text{lb}_{da}$

$h_1 = 34.6 \text{ BTU/lb}_{da}$
 $v_1 = 14.0 \text{ ft}^3/\text{lb}_{da}$
 $W_1 = 0.0129 \text{ lb}_w/\text{lb}_{da}$


Example 3: Mixing (IP)

- A stream of 5,000 CFM of outdoor air at 40°F dry bulb temperature and 35°F thermodynamic wet bulb temperature is adiabatically mixed with 15,000 CFM of recirculated air at 75°F dry bulb temperature and 50% RH
 - Find the dry bulb temperature, humidity ratio, and enthalpy of the resulting mixture

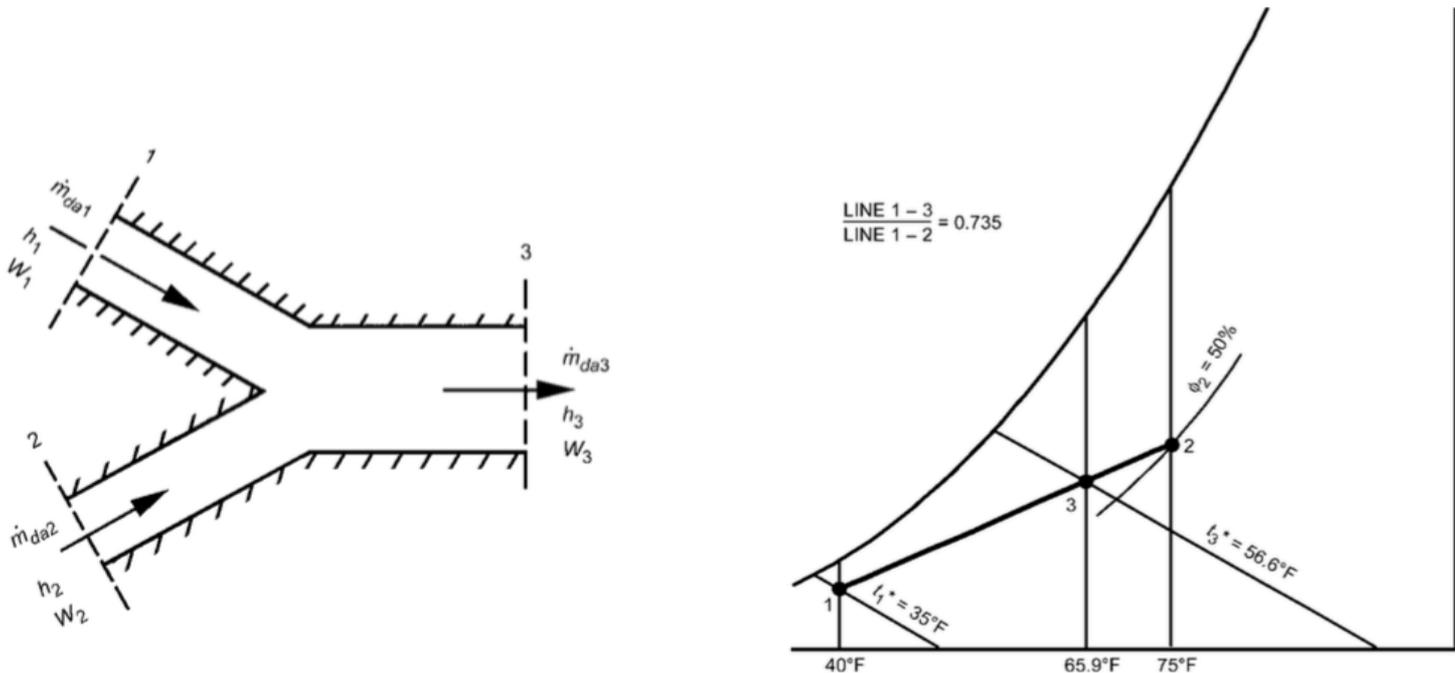

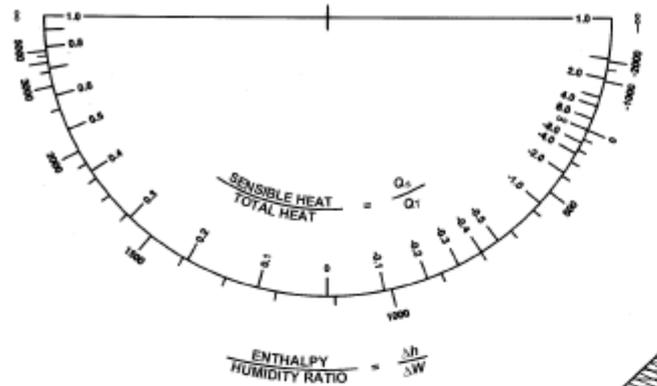

IP chart

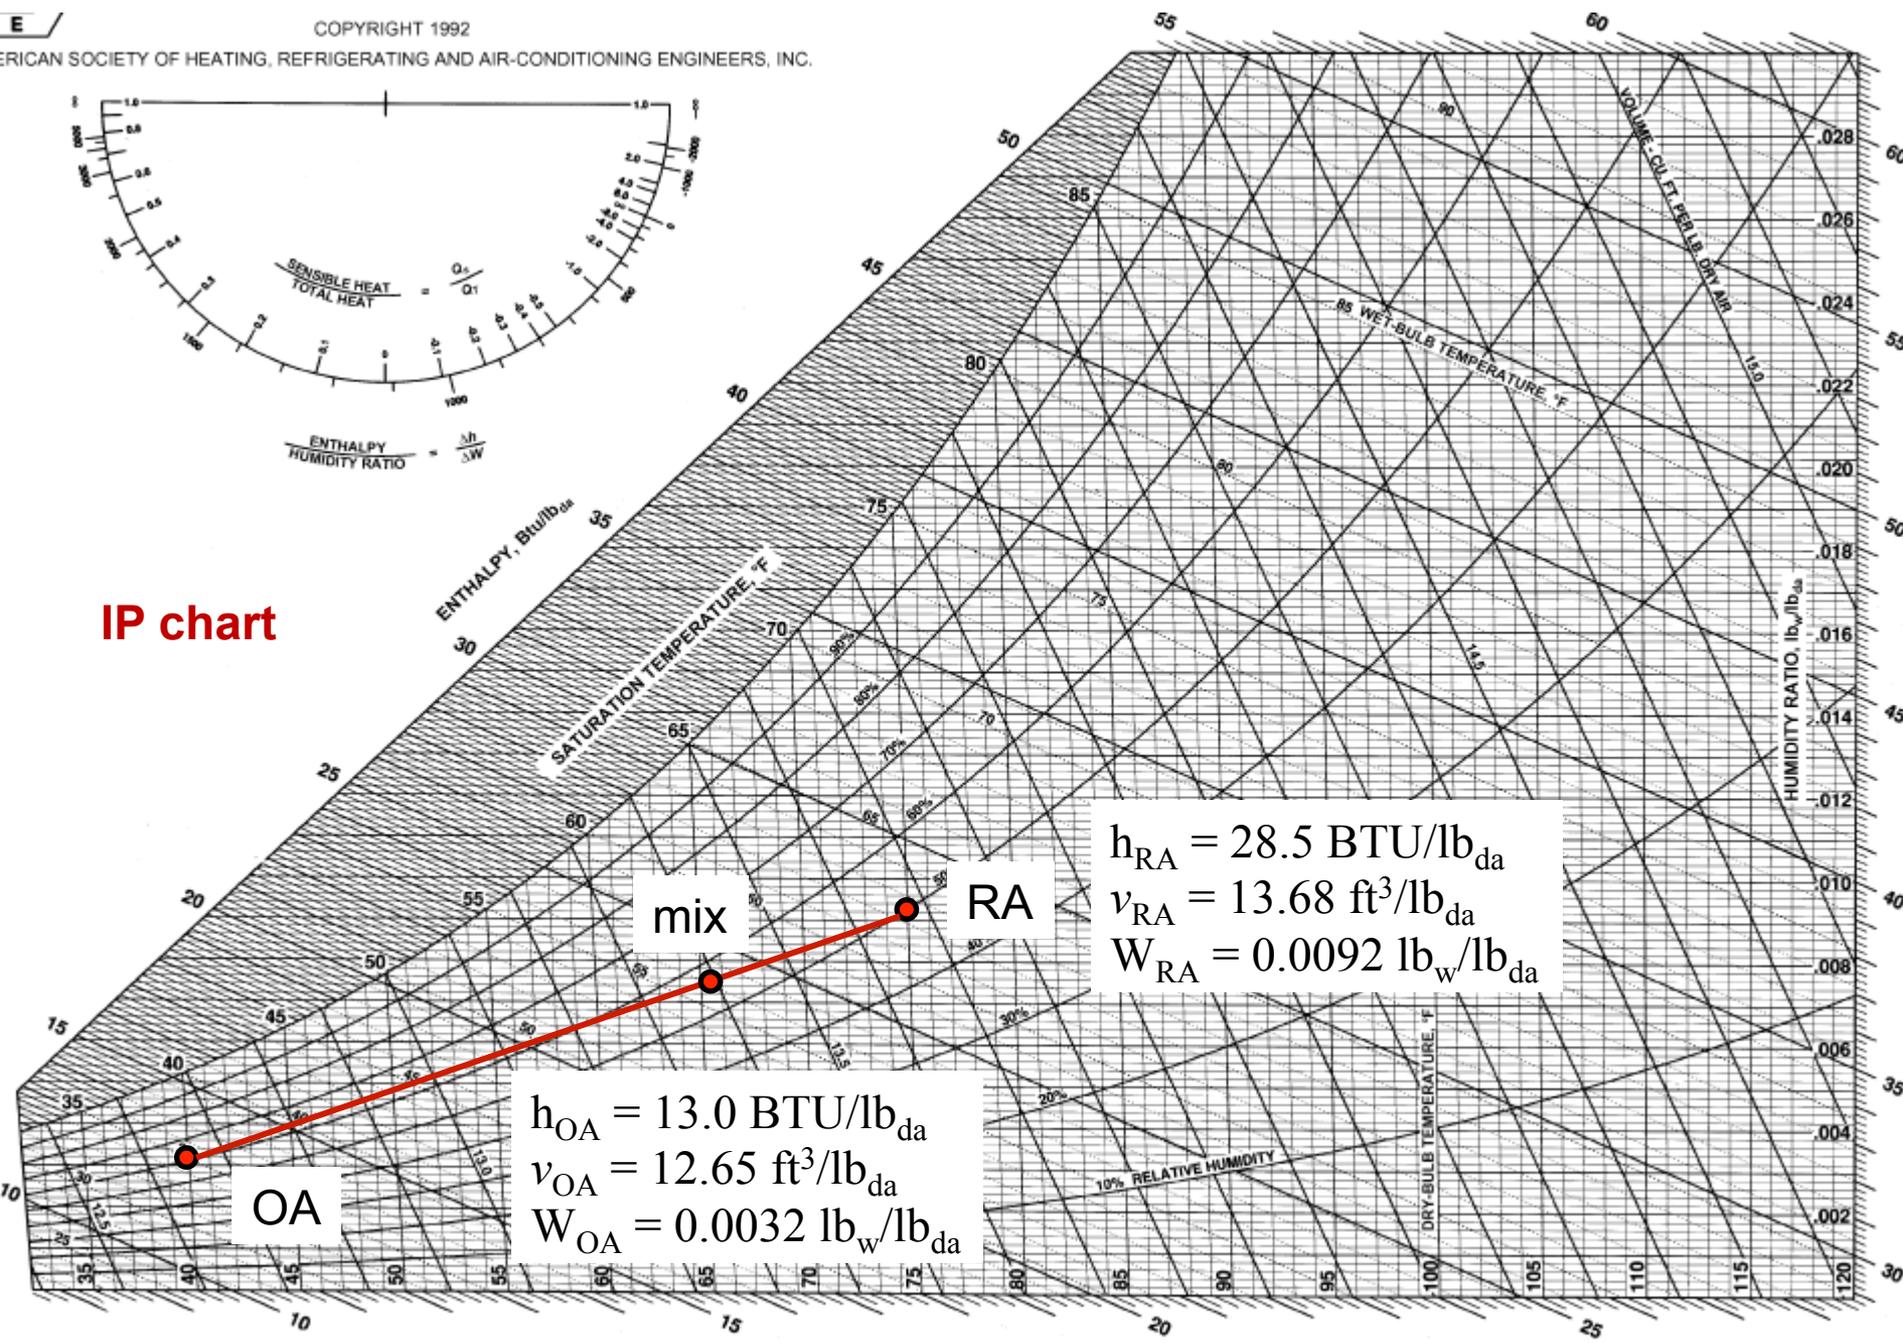

OA

mix


RA

$h_{OA} = 13.0 \text{ BTU/lb}_{da}$
 $v_{OA} = 12.65 \text{ ft}^3/\text{lb}_{da}$
 $W_{OA} = 0.0032 \text{ lb}_w/\text{lb}_{da}$

$h_{RA} = 28.5 \text{ BTU/lb}_{da}$
 $v_{RA} = 13.68 \text{ ft}^3/\text{lb}_{da}$
 $W_{RA} = 0.0092 \text{ lb}_w/\text{lb}_{da}$

Example 4: Mixing (SI)

- Hot, humid outdoor air is mixed with recirculated indoor air at an outdoor air mass flow fraction of 35%
 - Q1: What is T , W , RH , and h at the mixed condition?


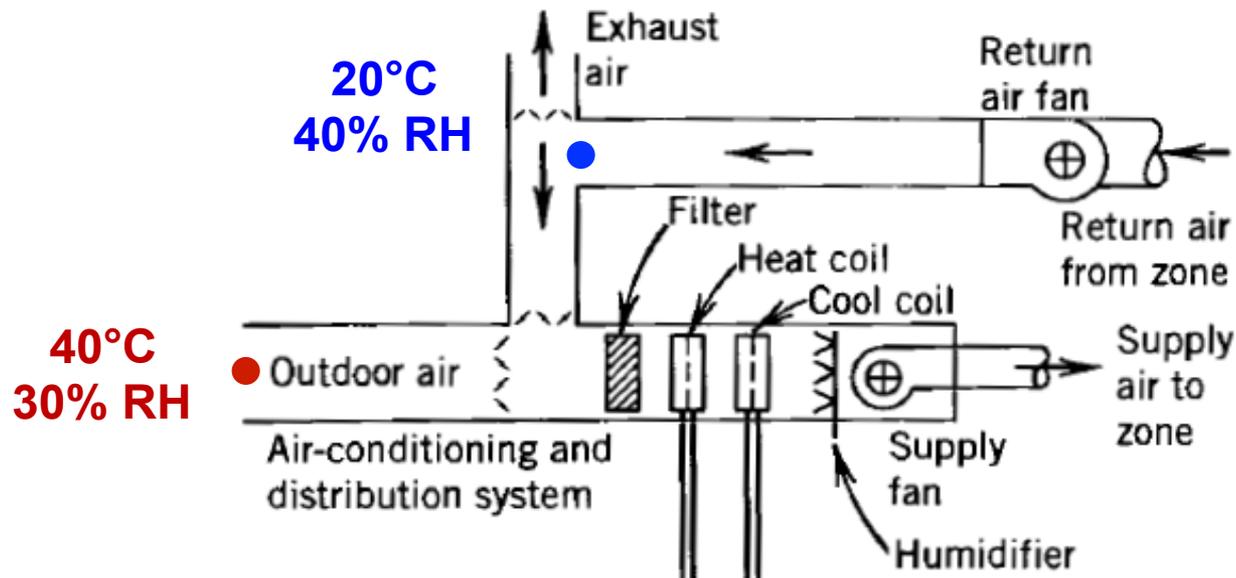




ASHRAE PSYCHROMETRIC CHART NO.1
NORMAL TEMPERATURE SEA LEVEL
BAROMETRIC PRESSURE: 101.325 kPa
COPYRIGHT 1992

Mixing of airstreams

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

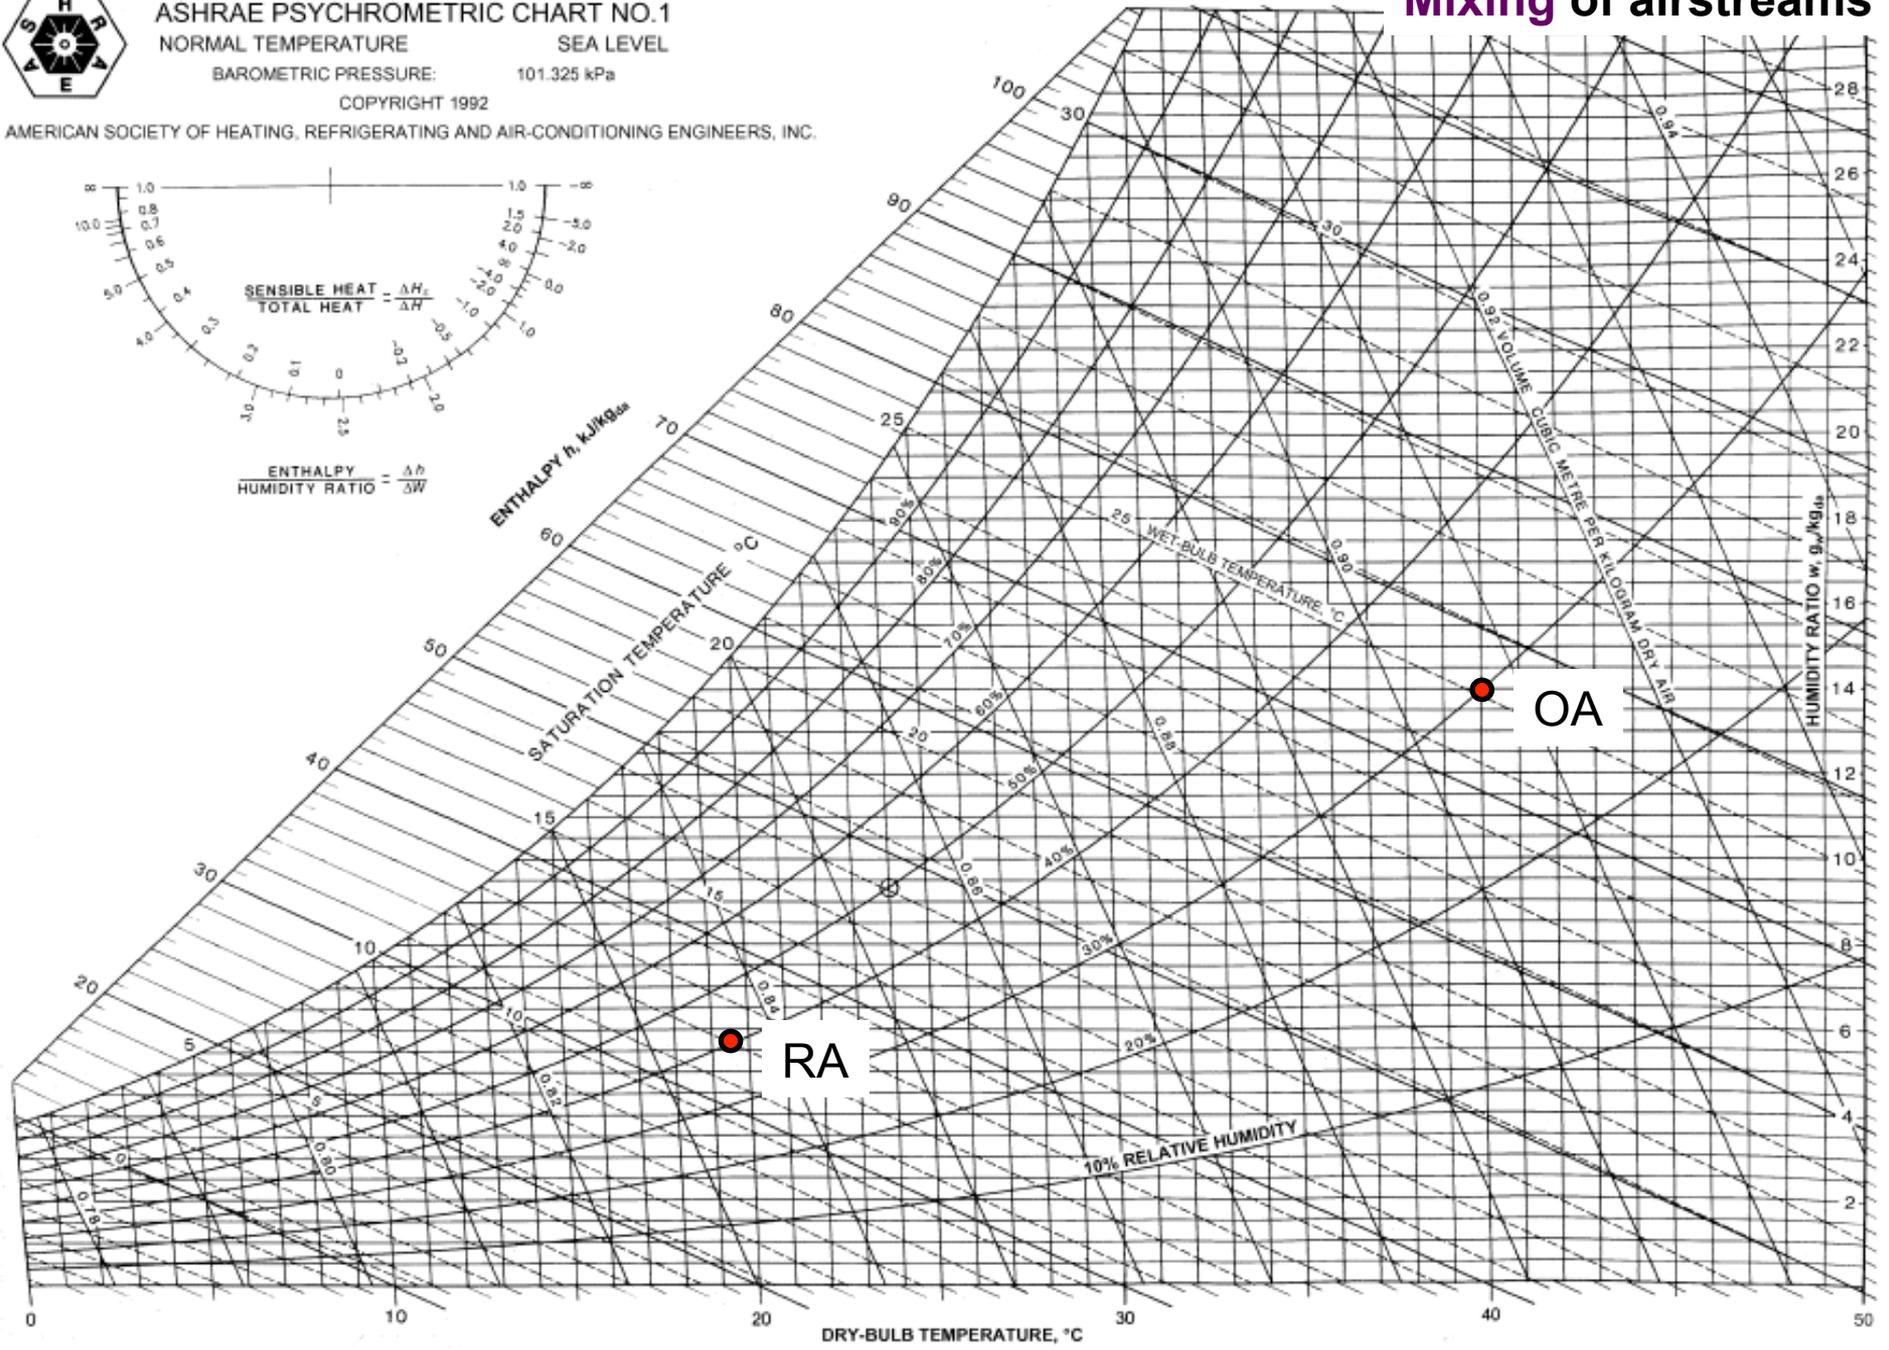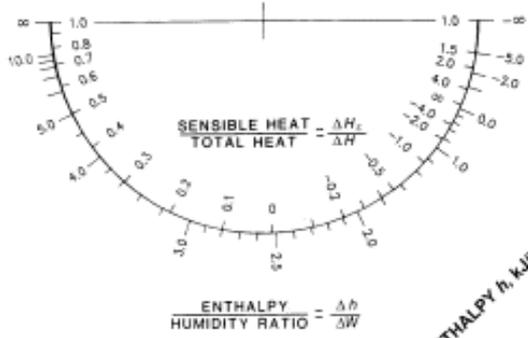





ASHRAE PSYCHROMETRIC CHART NO.1
 NORMAL TEMPERATURE SEA LEVEL
 BAROMETRIC PRESSURE: 101.325 kPa
 COPYRIGHT 1992

Mixing of airstreams

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

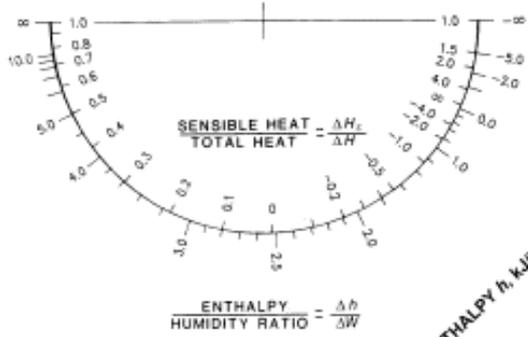

OA fraction = 35%

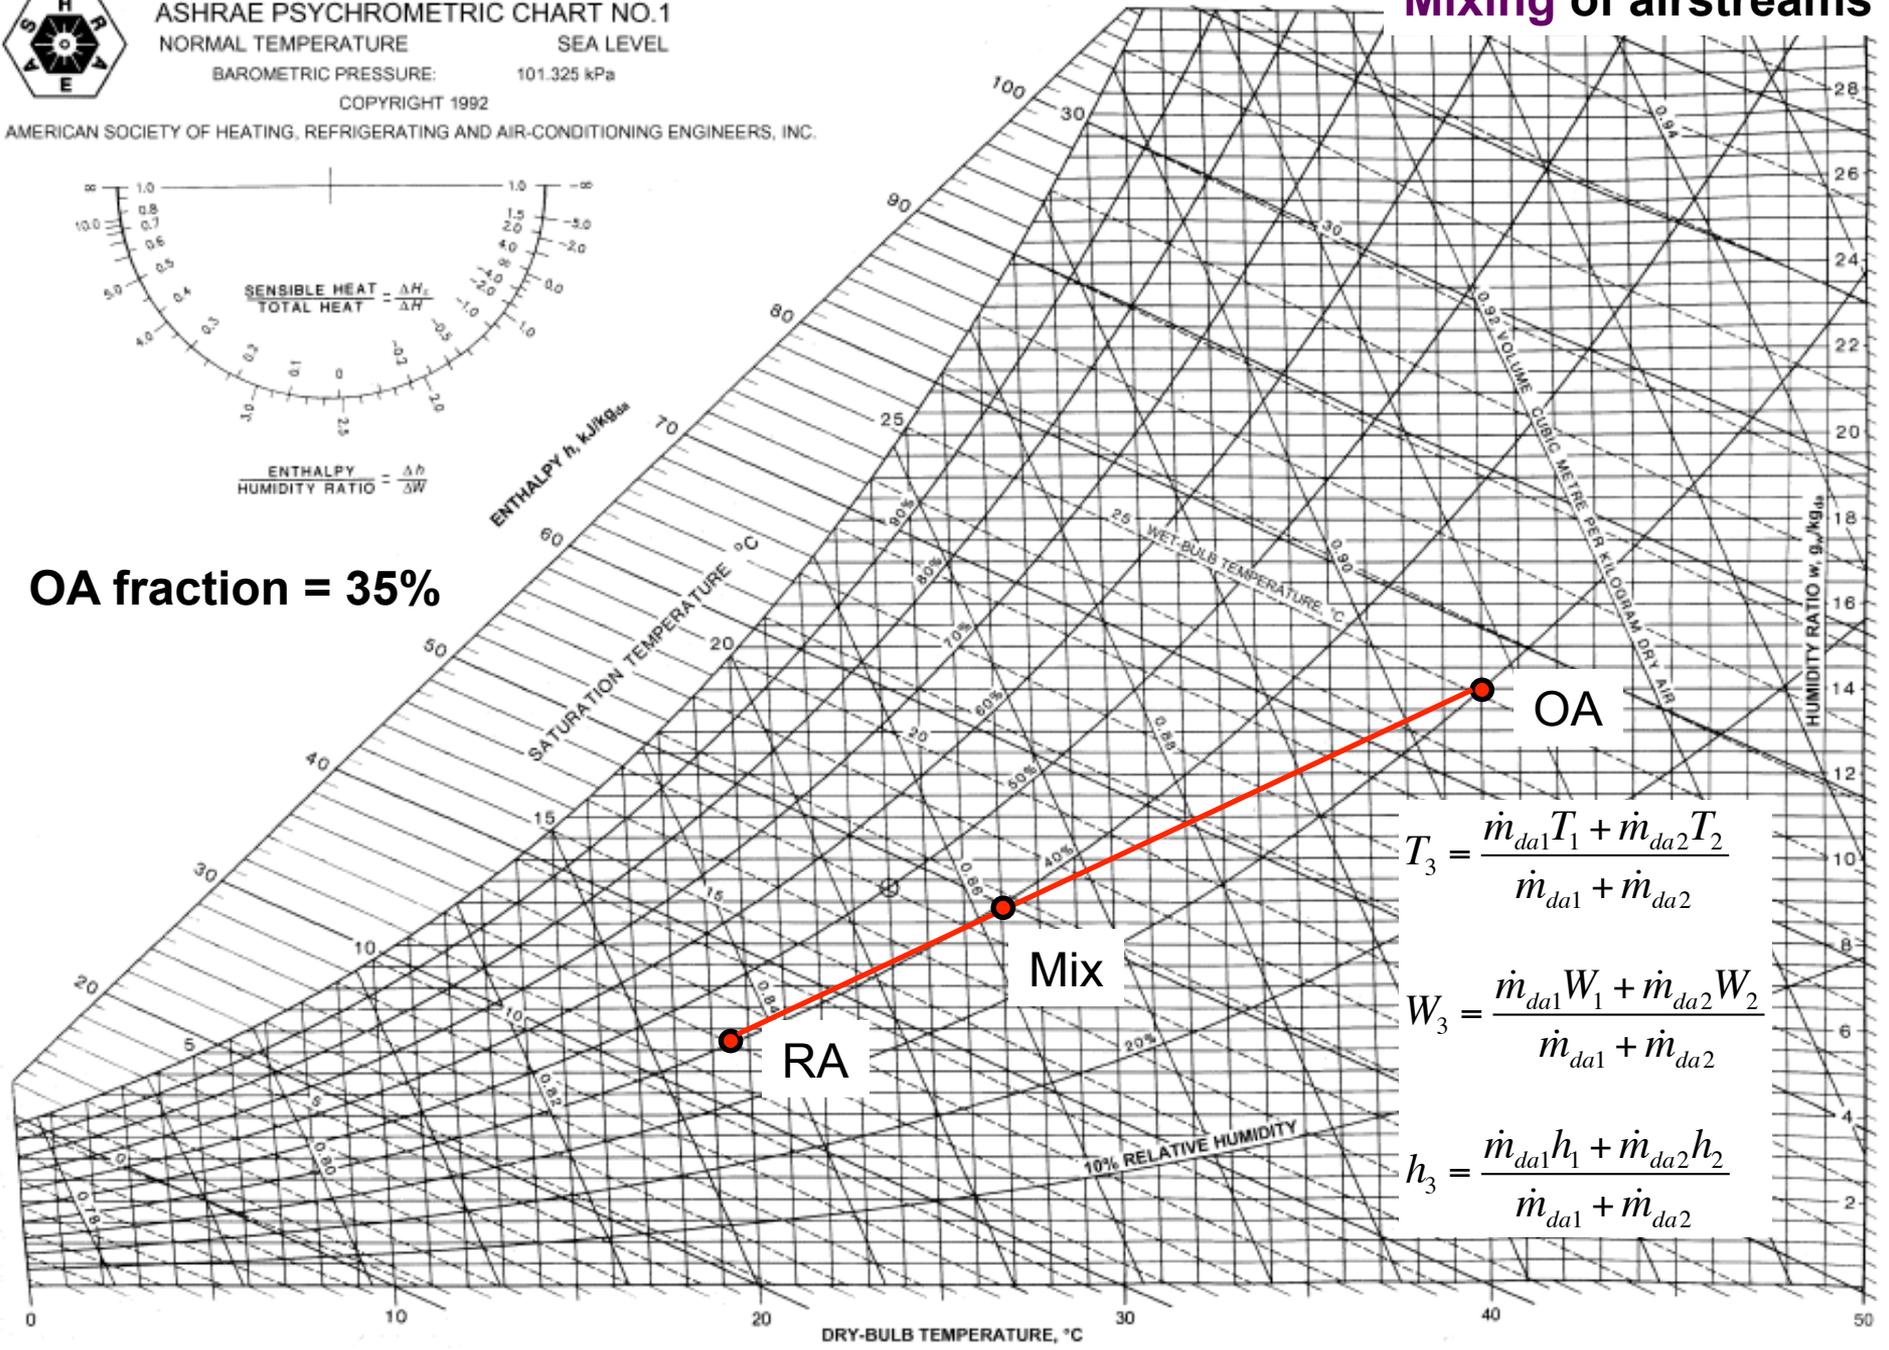

$$T_3 = \frac{\dot{m}_{da1} T_1 + \dot{m}_{da2} T_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$

$$W_3 = \frac{\dot{m}_{da1} W_1 + \dot{m}_{da2} W_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$


$$h_3 = \frac{\dot{m}_{da1} h_1 + \dot{m}_{da2} h_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$




ASHRAE PSYCHROMETRIC CHART NO.1
 NORMAL TEMPERATURE
 SEA LEVEL
 BAROMETRIC PRESSURE: 101.325 kPa
 COPYRIGHT 1992

Mixing of airstreams

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

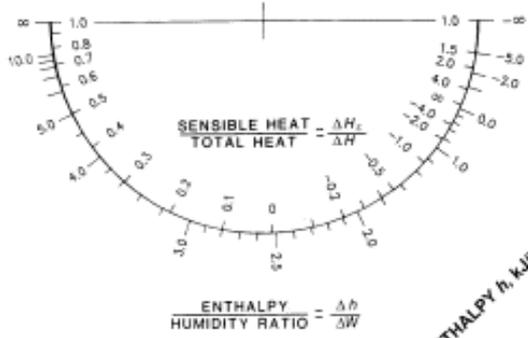

OA fraction = 35%

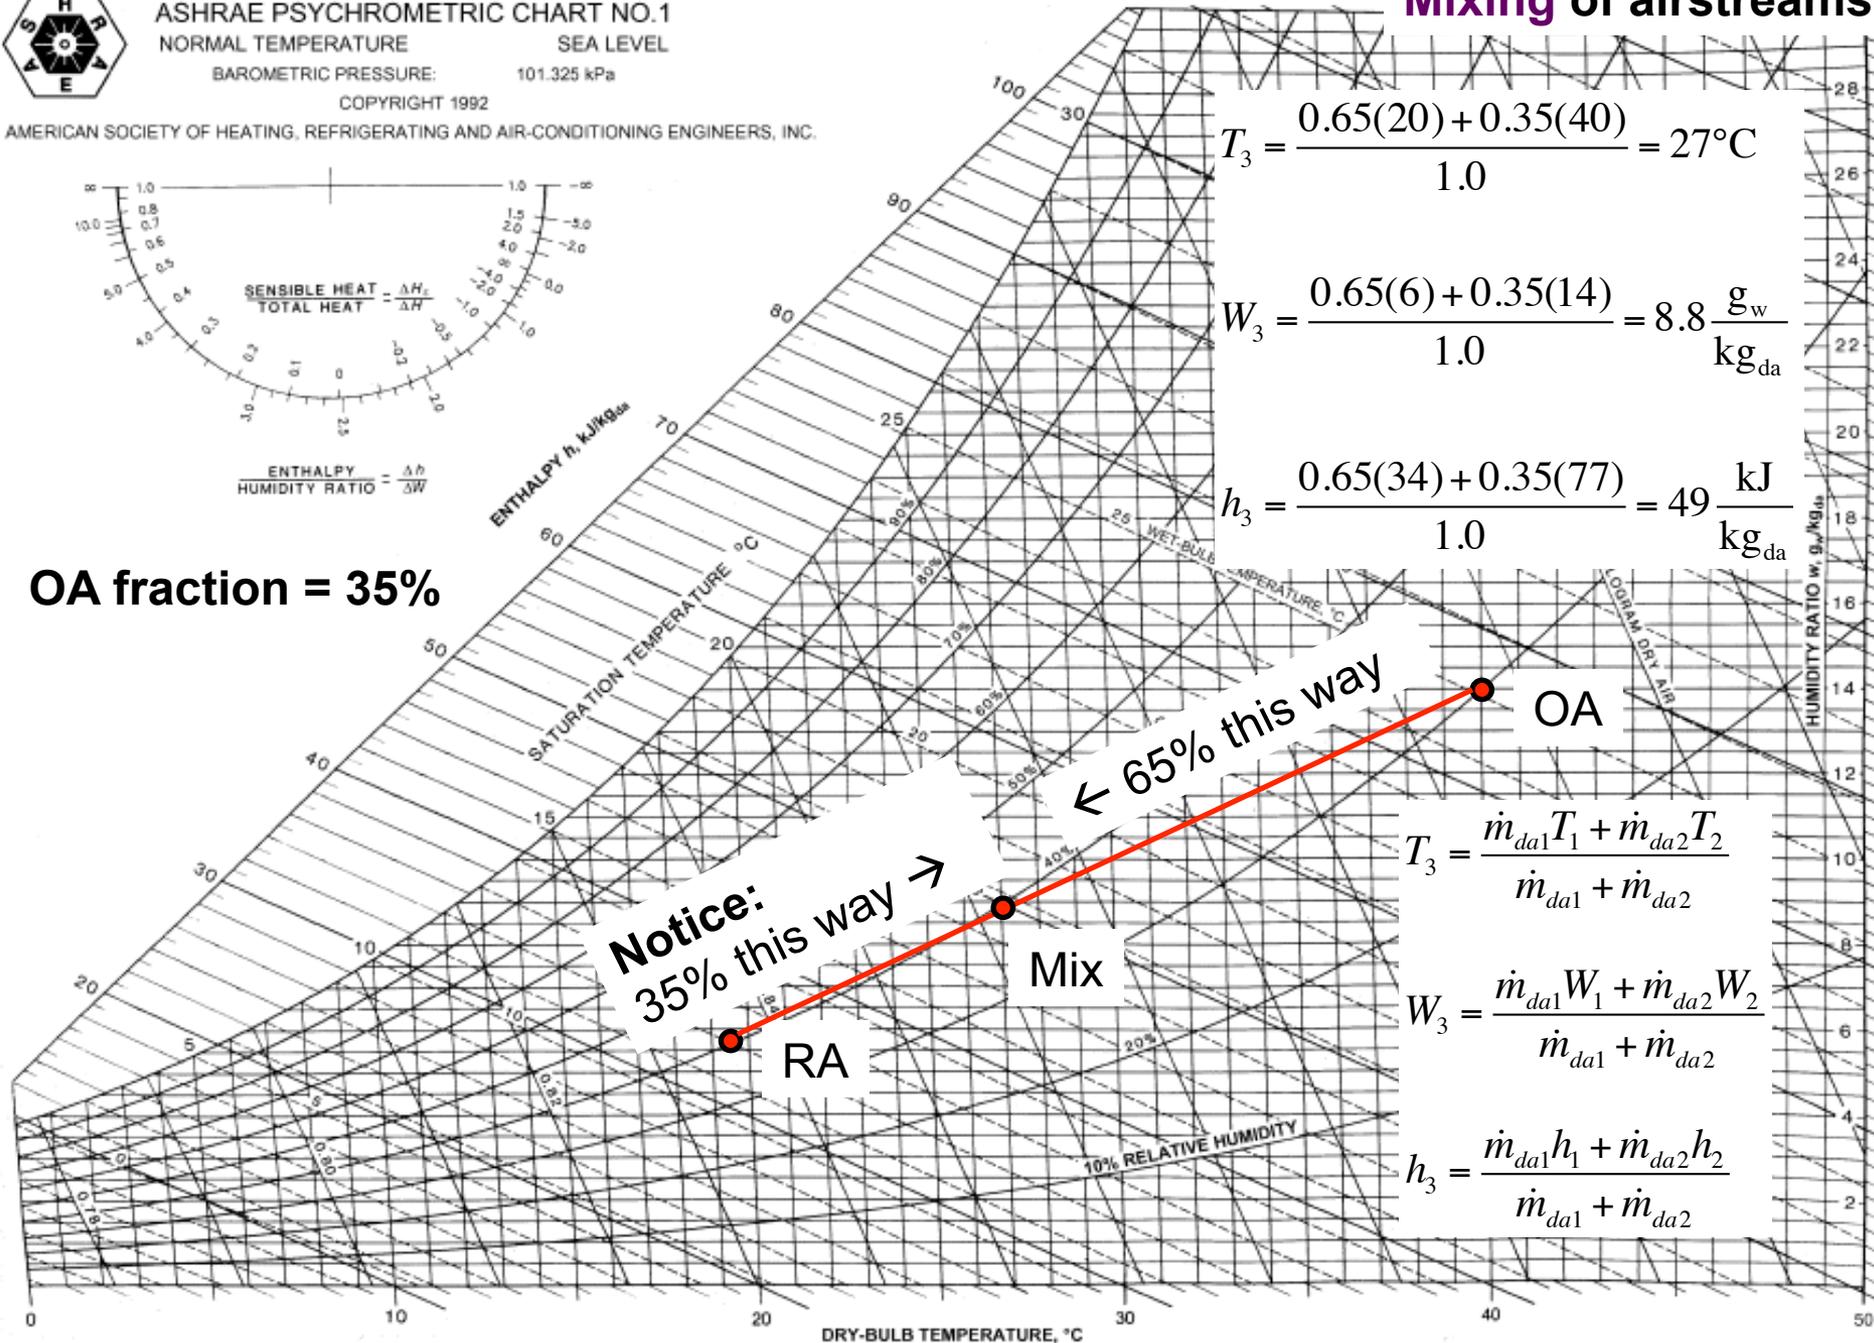

$$T_3 = \frac{0.65(20) + 0.35(40)}{1.0} = 27^\circ\text{C}$$

$$W_3 = \frac{0.65(6) + 0.35(14)}{1.0} = 8.8 \frac{\text{g}_w}{\text{kg}_{da}}$$

$$h_3 = \frac{0.65(34) + 0.35(77)}{1.0} = 49 \frac{\text{kJ}}{\text{kg}_{da}}$$


$$T_3 = \frac{\dot{m}_{da1}T_1 + \dot{m}_{da2}T_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$


$$W_3 = \frac{\dot{m}_{da1}W_1 + \dot{m}_{da2}W_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$

$$h_3 = \frac{\dot{m}_{da1}h_1 + \dot{m}_{da2}h_2}{\dot{m}_{da1} + \dot{m}_{da2}}$$


Example 5: Humidification (IP)


- Moist air at 70°F dry bulb temperature and 45°F wet bulb temperature is to be processed to a final dew point of 55°F by adiabatic injection of saturated steam at 230°F
- The air flow rate is 10,000 CFM
 - Find the rate of steam flow required

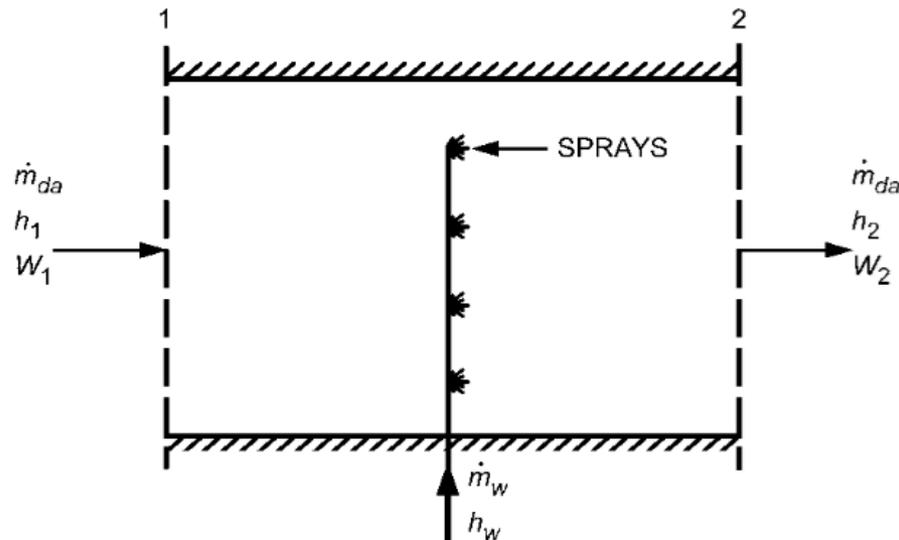


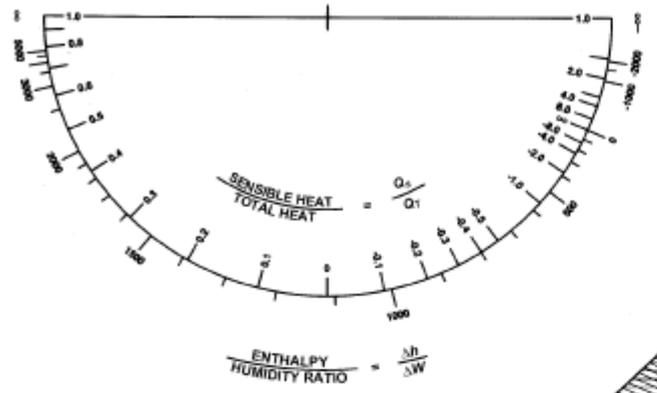


IP chart

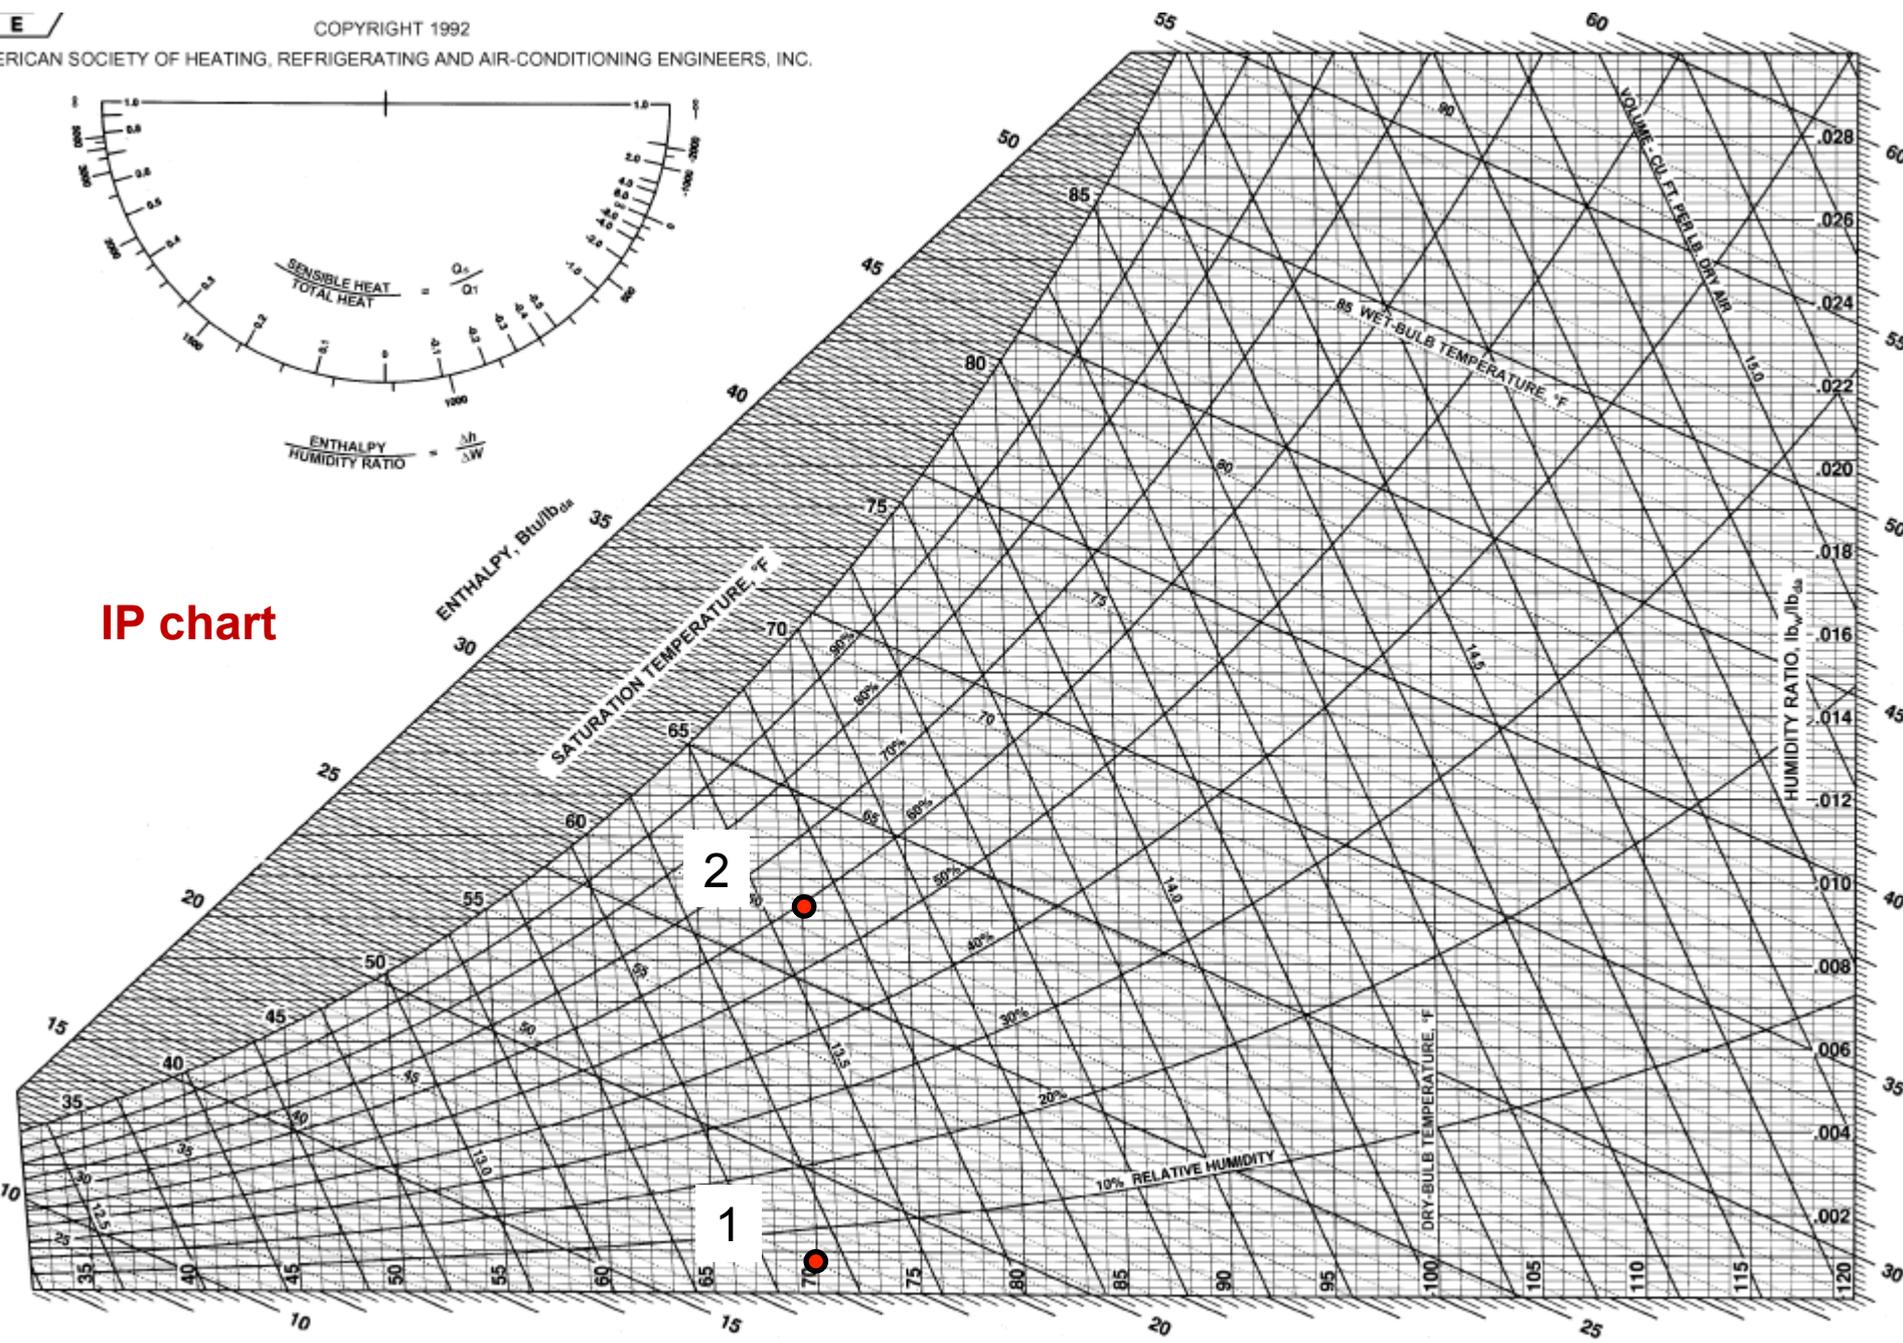

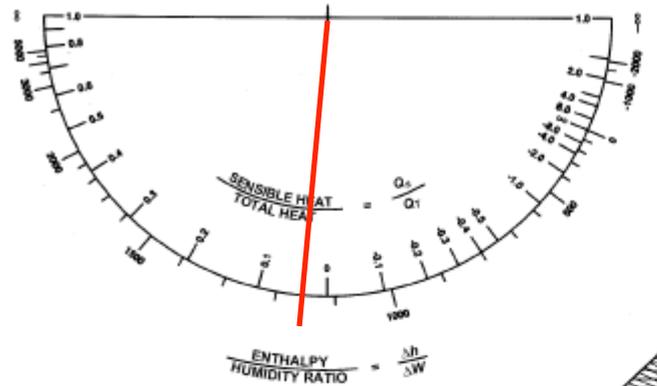


$$\frac{\Delta h}{\Delta W} = 1157 \frac{\text{BTU}}{\text{lb}_w}$$

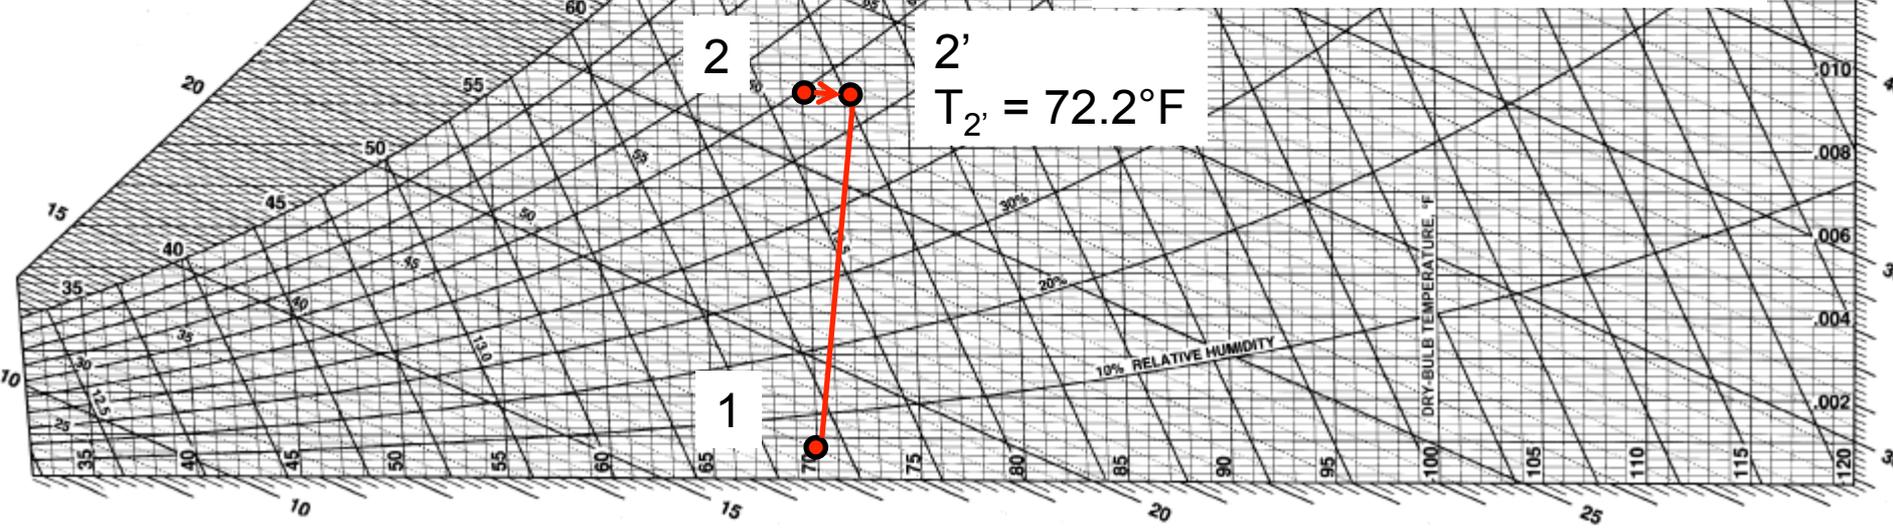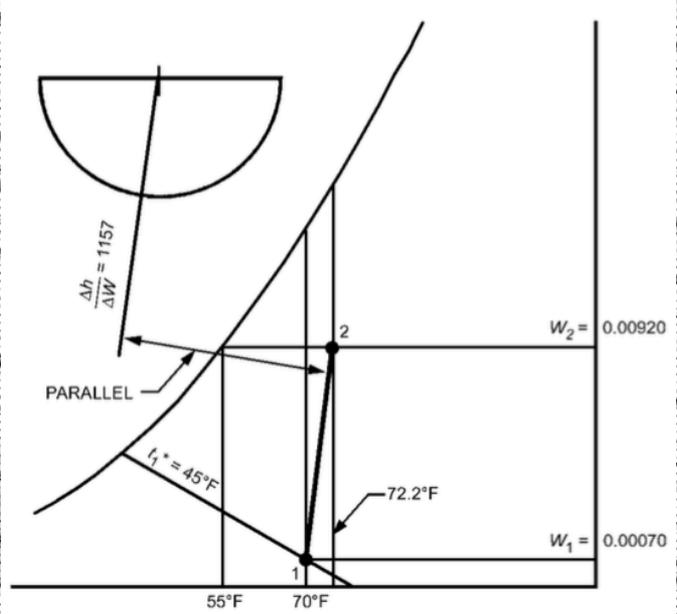


Example 6: Heating and humidification (IP)

- Moist air is heated and humidified by passing it first over a heating coil and then adding moisture. The moist air enters the system at 40°F dry bulb temperature and 36°F wet bulb temperature at a mass flow rate of $235 \text{ lb}_{\text{da}}/\text{min}$. The humidifier injects saturated steam at 230°F . The moist air exists the system at 90°F dry bulb temperature and 40% RH.
- Locate state 2 on a psychrometric chart and determine the rate of heat addition by the heating coil and the rate of mass addition by the humidifier.

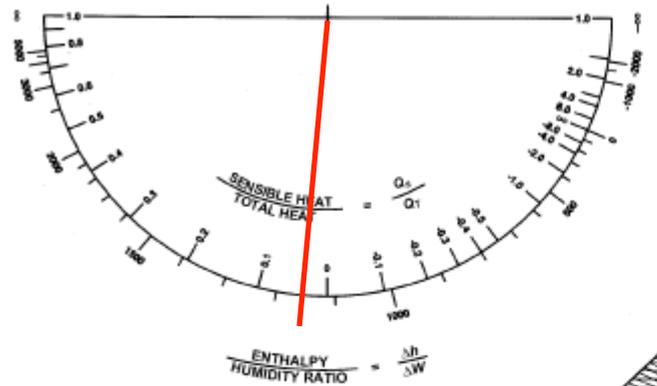

$$\frac{\Delta h}{\Delta W} = 1157 \frac{\text{BTU}}{\text{lb}_w}$$

IP chart

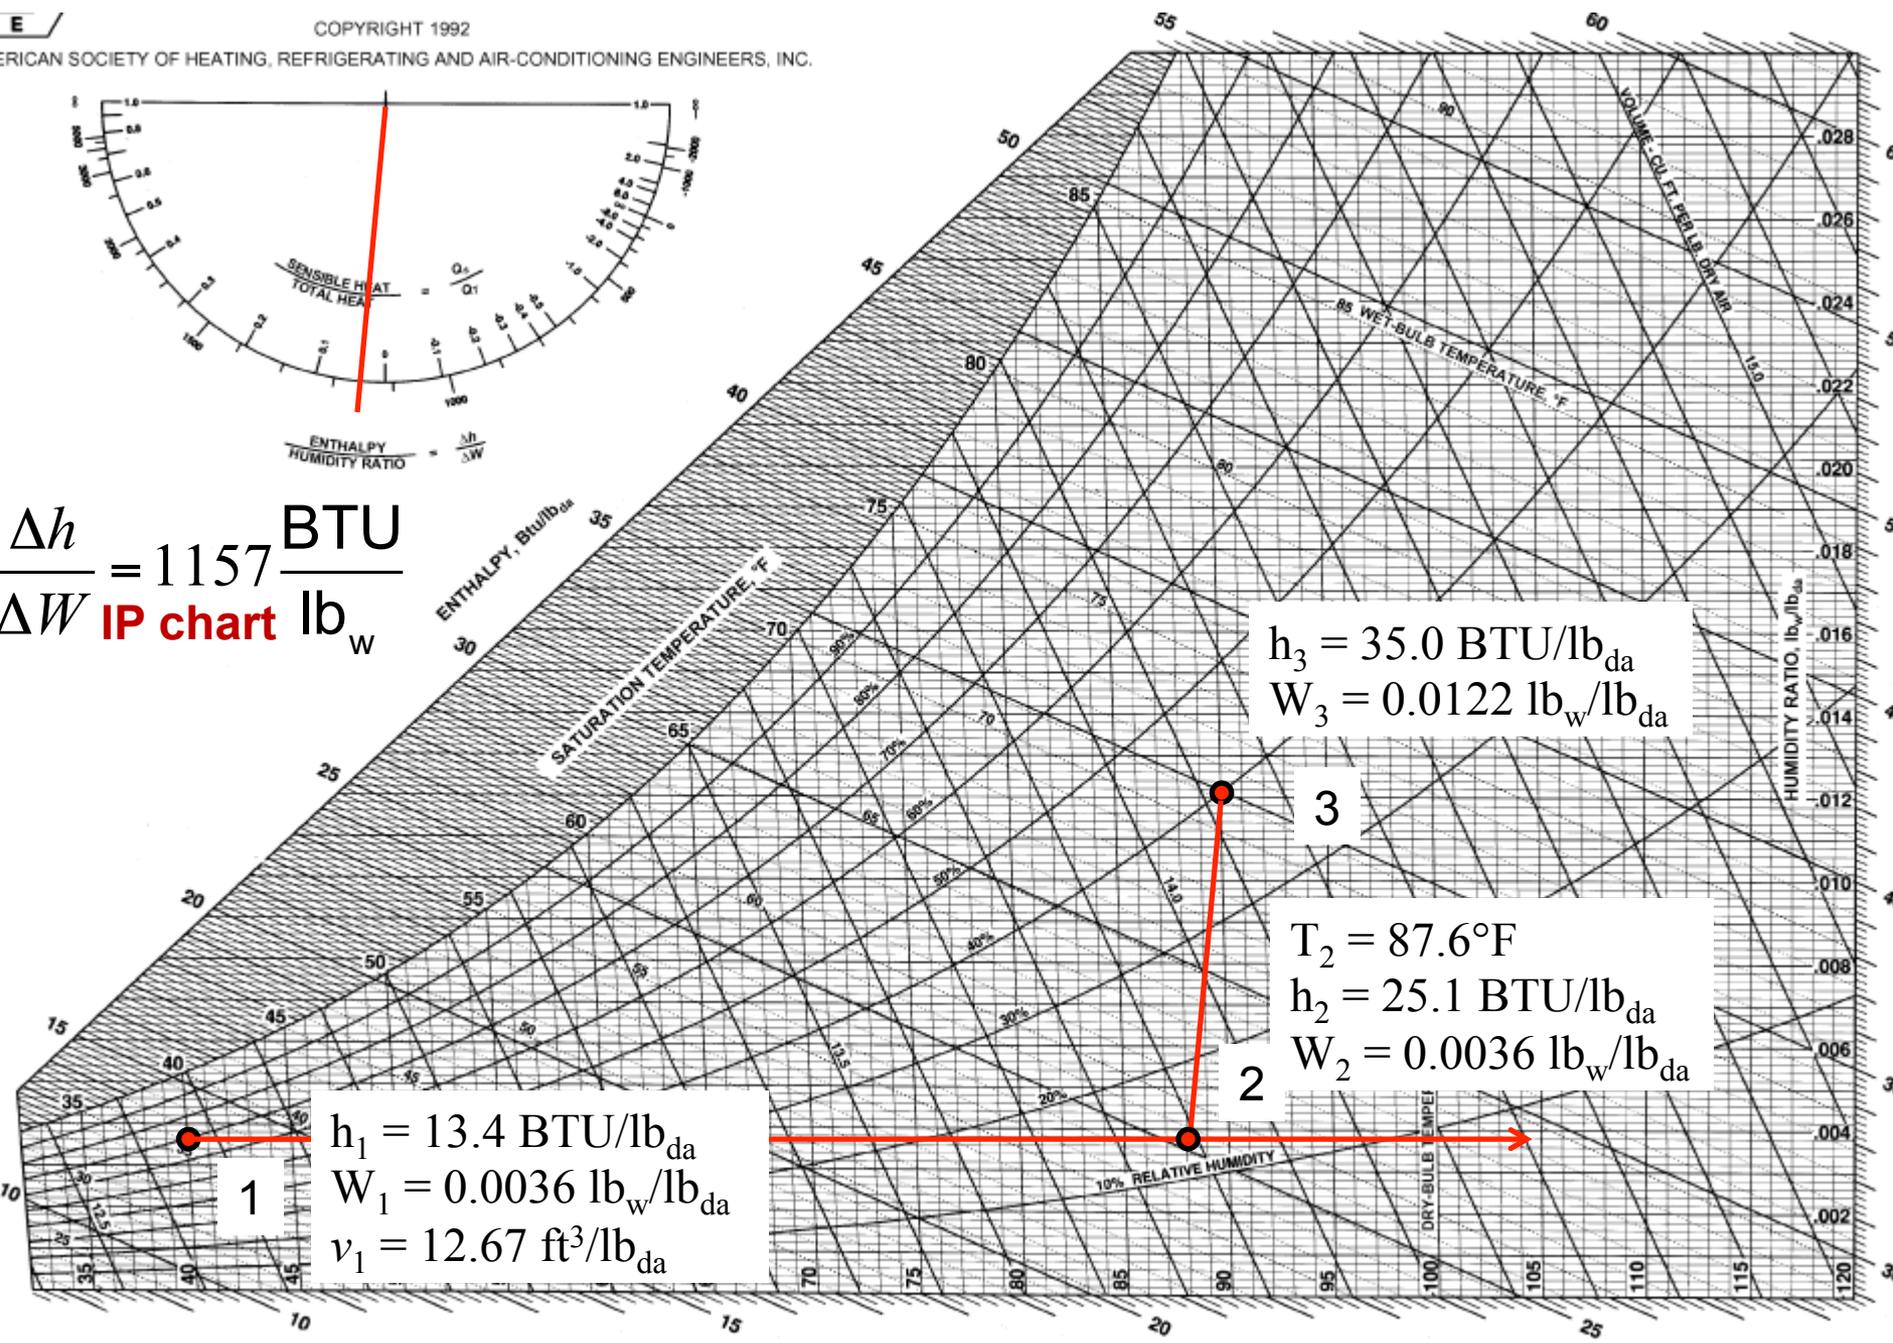

1

$h_1 = 13.4 \text{ BTU/lb}_{da}$
 $W_1 = 0.0036 \text{ lb}_w/\text{lb}_{da}$
 $v_1 = 12.67 \text{ ft}^3/\text{lb}_{da}$

2

$T_2 = 87.6^\circ\text{F}$
 $h_2 = 25.1 \text{ BTU/lb}_{da}$
 $W_2 = 0.0036 \text{ lb}_w/\text{lb}_{da}$

3


$h_3 = 35.0 \text{ BTU/lb}_{da}$
 $W_3 = 0.0122 \text{ lb}_w/\text{lb}_{da}$

Example 7: Space conditioning – cooling (IP)

- The air in a restaurant is to be maintained at 75°F dry-bulb temperature and 50% RH. The load calculations for the restaurant estimate the rate of sensible heat gain to be 178,000 BTU/h. The rate of moisture gain is estimated to be 95 lb_w/h with an average enthalpy of moisture (h_w) of 1095 BTU/lb_w. The supply air temperature is to be 60°F. Assume standard atmospheric pressure.
- Determine the following:
 - a) The required dew-point temperature of the supply air
 - b) The required volumetric flow rate of supply air (in CFM)

$$(h_2 - h_1)/(W_2 - W_1) = 2968 \text{ BTU/lb}_w$$

IP chart

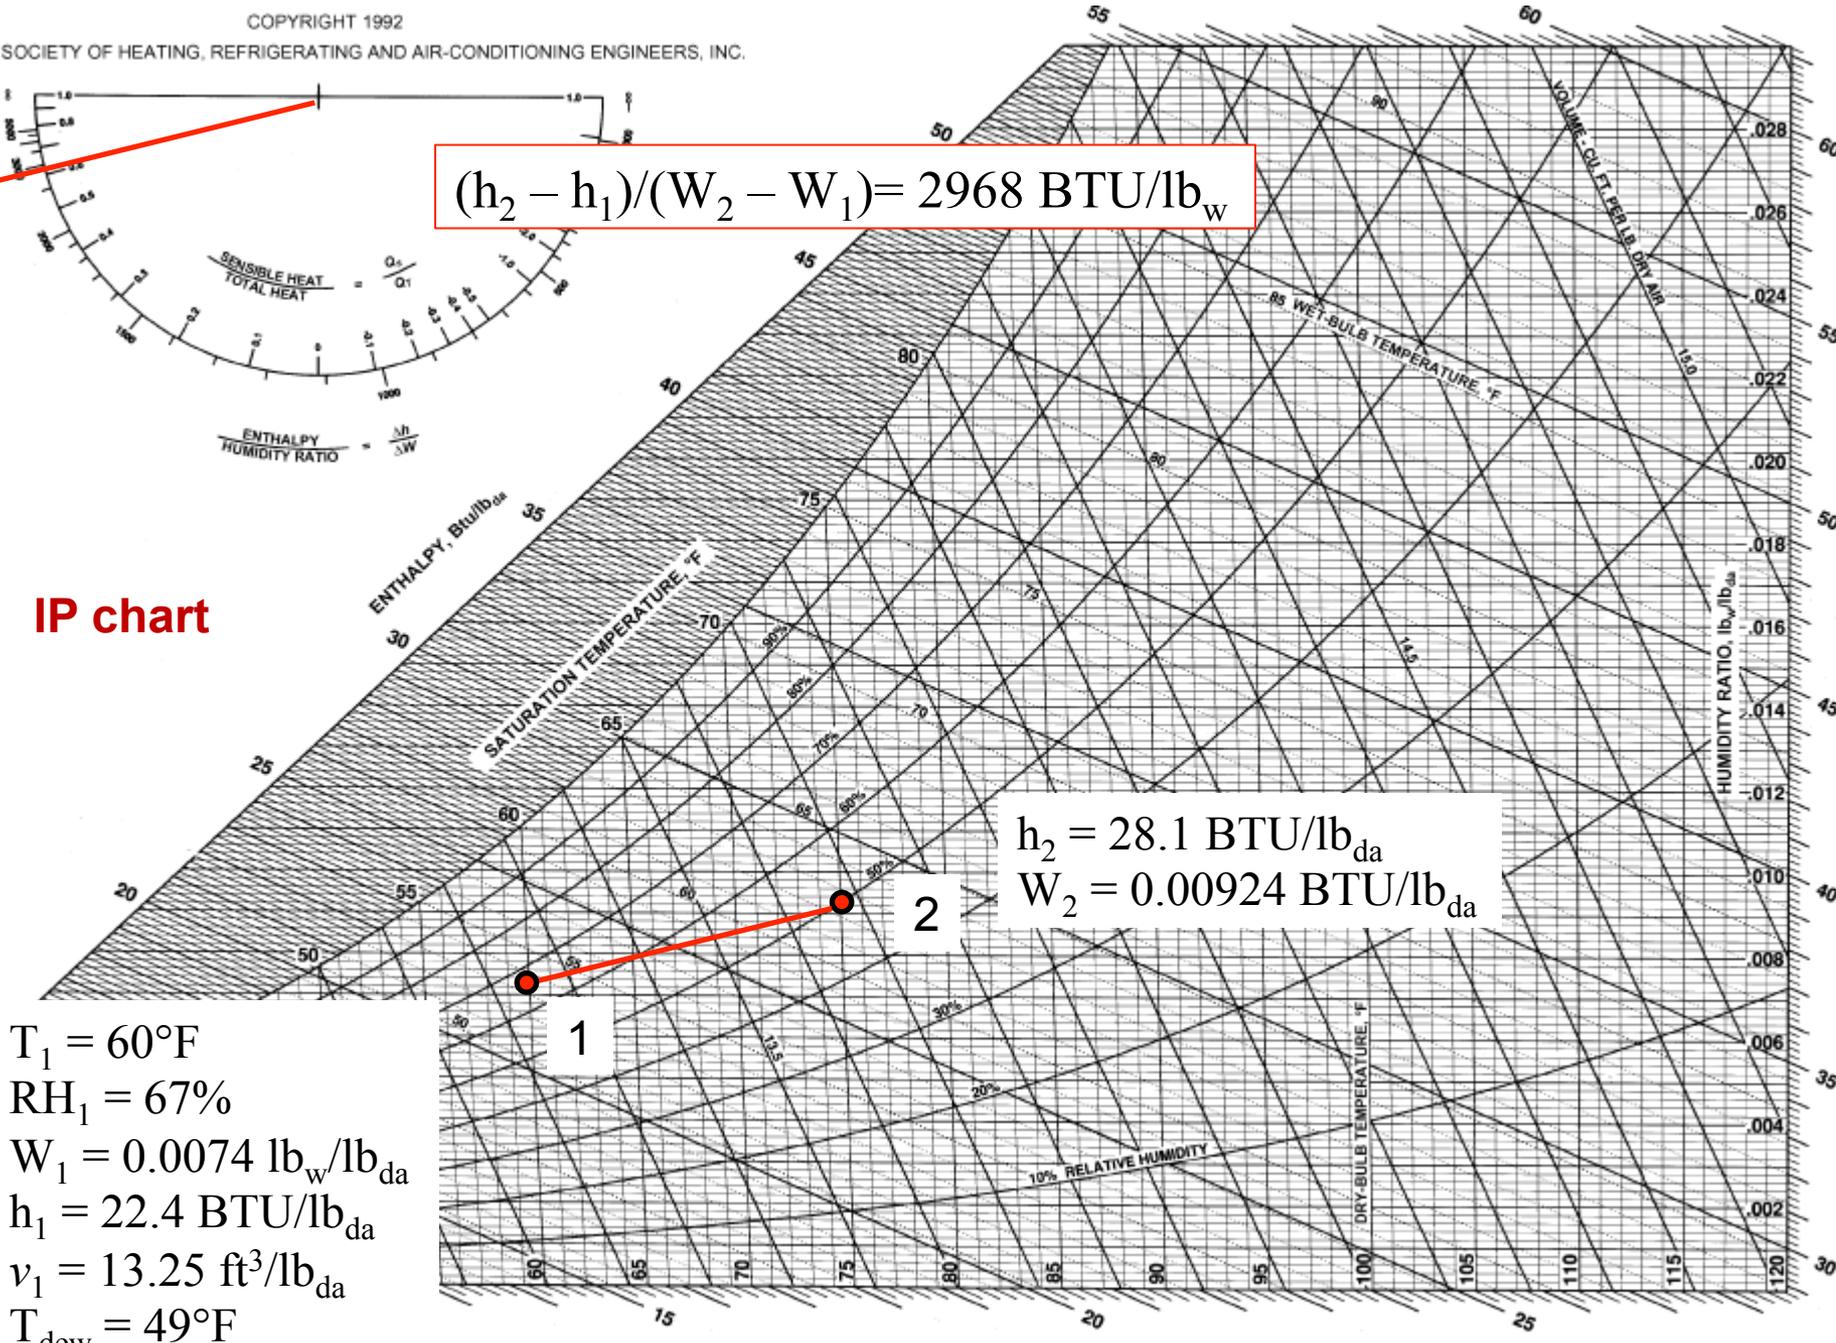

$$h_2 = 28.1 \text{ BTU/lb}_{da}$$

$$W_2 = 0.00924 \text{ BTU/lb}_{da}$$

$T_1 = 60^{\circ}\text{F}$
 $\text{RH}_1 = 67\%$
 $W_1 = 0.0074 \text{ lb}_w/\text{lb}_{da}$
 $h_1 = 22.4 \text{ BTU/lb}_{da}$
 $v_1 = 13.25 \text{ ft}^3/\text{lb}_{da}$
 $T_{\text{dew}} = 49^{\circ}\text{F}$

1


2

Example 8: Single-zone space conditioning (IP)

- Assume the restaurant from the previous example is to be served by an air handling unit that mixes outdoor air with recirculated air, then passes the air over a cooling coil to the space. Outside air conditions are 92°F dry bulb and 77°F wet bulb temperatures. The rate of exhaust from the restaurant is 4500 CFM.
- Determine the following:
 - a) The mass flow rate of recirculated air
 - b) The thermodynamic state of the moist air entering the cooling coil
 - c) The refrigeration capacity required

$$(h_2 - h_1)/(W_2 - W_1) = 2968 \text{ BTU/lb}_w$$

IP chart

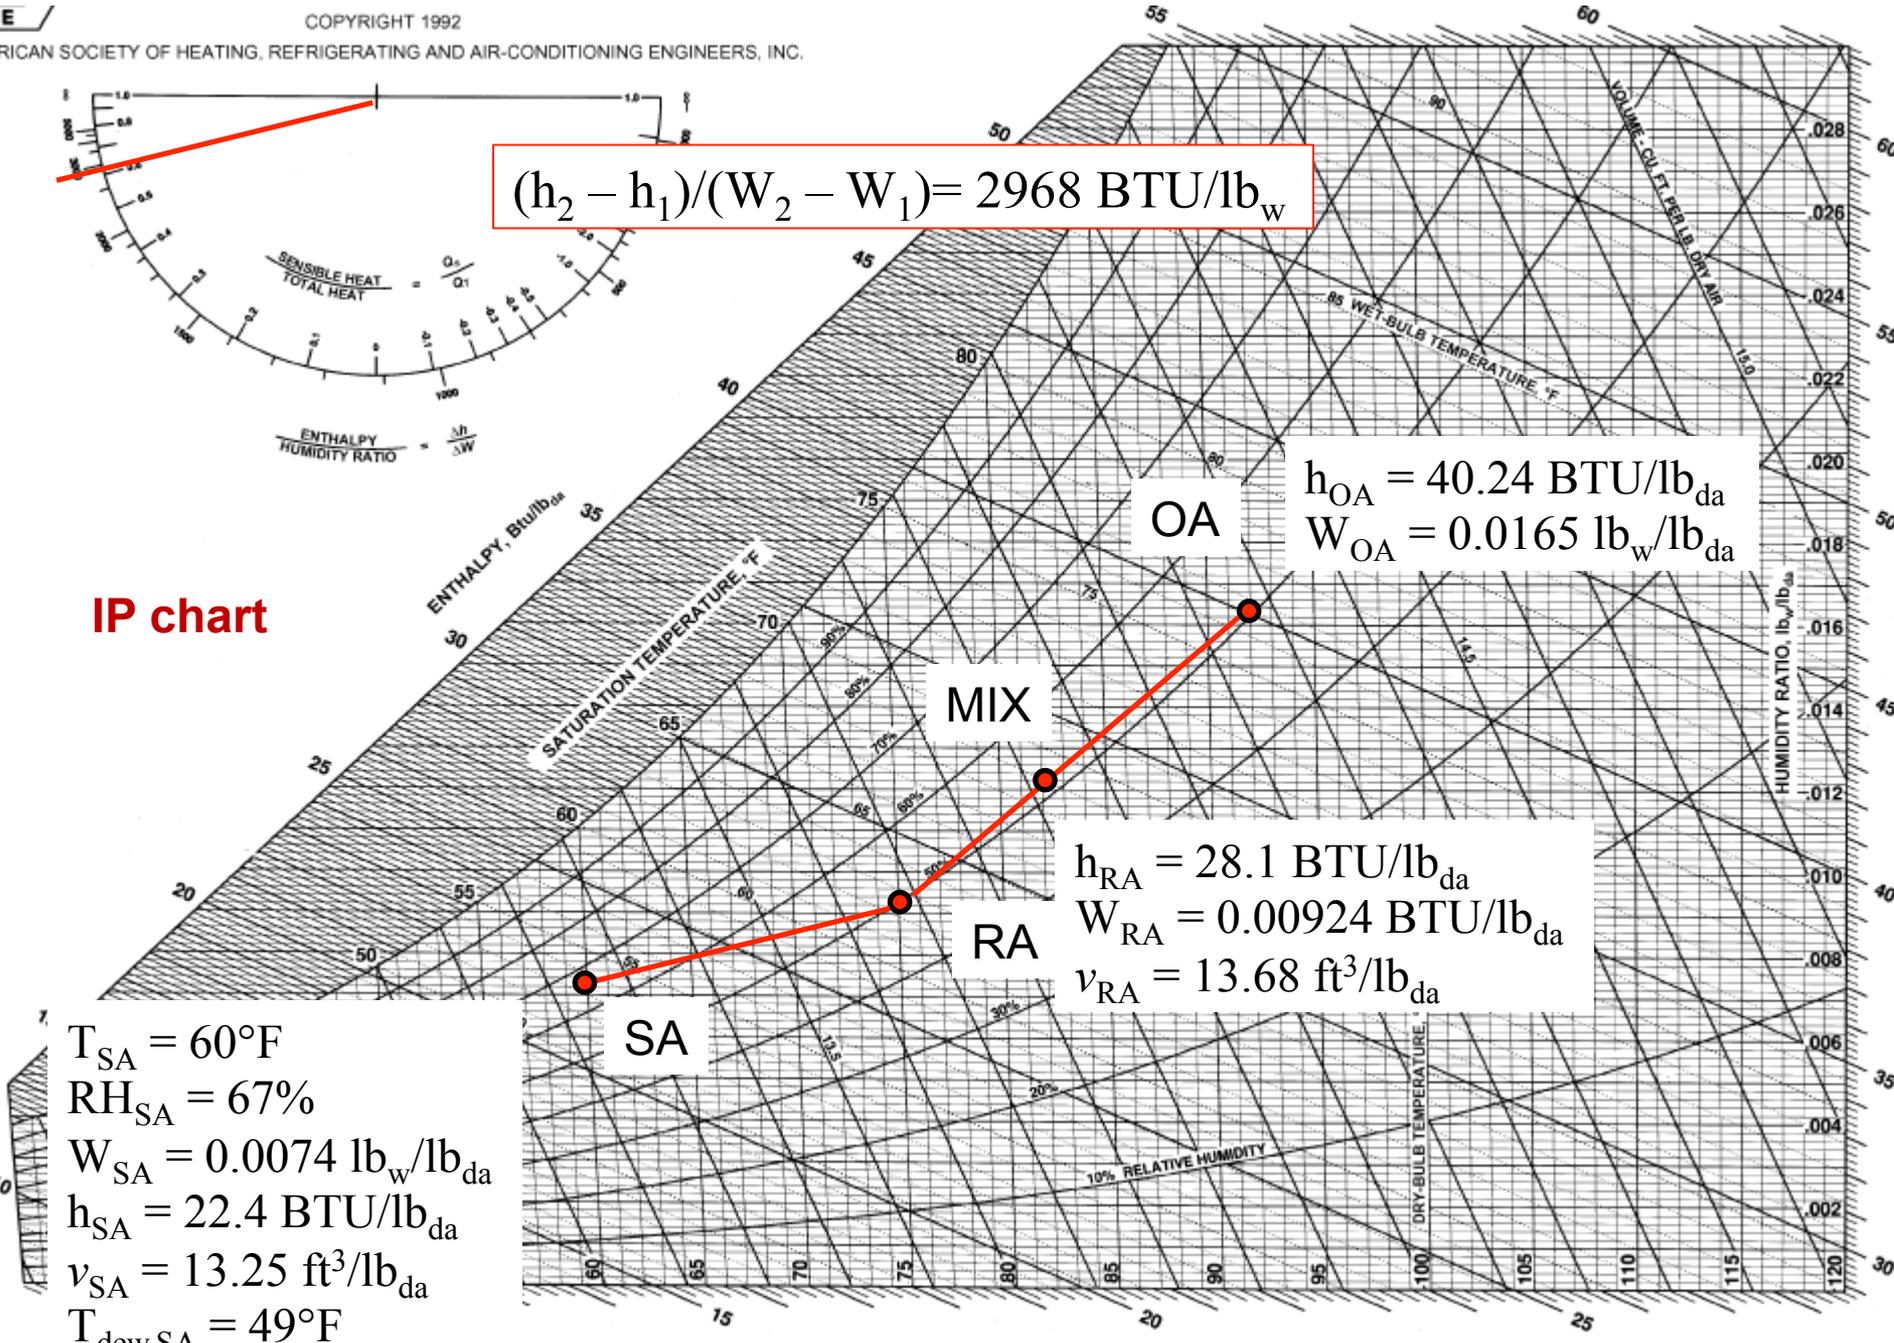

$T_{SA} = 60^\circ\text{F}$
 $RH_{SA} = 67\%$
 $W_{SA} = 0.0074 \text{ lb}_w/\text{lb}_{da}$
 $h_{SA} = 22.4 \text{ BTU}/\text{lb}_{da}$
 $v_{SA} = 13.25 \text{ ft}^3/\text{lb}_{da}$
 $T_{dew,SA} = 49^\circ\text{F}$

$h_{OA} = 40.24 \text{ BTU}/\text{lb}_{da}$
 $W_{OA} = 0.0165 \text{ lb}_w/\text{lb}_{da}$

$h_{RA} = 28.1 \text{ BTU}/\text{lb}_{da}$
 $W_{RA} = 0.00924 \text{ lb}_w/\text{lb}_{da}$
 $v_{RA} = 13.68 \text{ ft}^3/\text{lb}_{da}$

HW #4 assigned

- HW #4 assigned, due Thursday, October 19