

CAE 464/517 HVAC Systems Design

Spring 2023

February 09, 2023

Heating and cooling loads calculation examples

Built
Environment
Research

@ IIT



*Advancing energy, environmental, and
sustainability research within the built environment*

www.built-envi.com

Dr. Mohammad Heidarinejad, Ph.D., P.E.
Civil, Architectural and Environmental Engineering
Illinois Institute of Technology

muh182@iit.edu

ANNOUNCEMENTS


Announcements

- Homework 2 is graded, and the solution is posted
- Homework 3 Part (a) is due tonight
- How was the Revit training?
- Group composition

RECAP

Recap

- Radiant Transfer Series Method (RTSM)

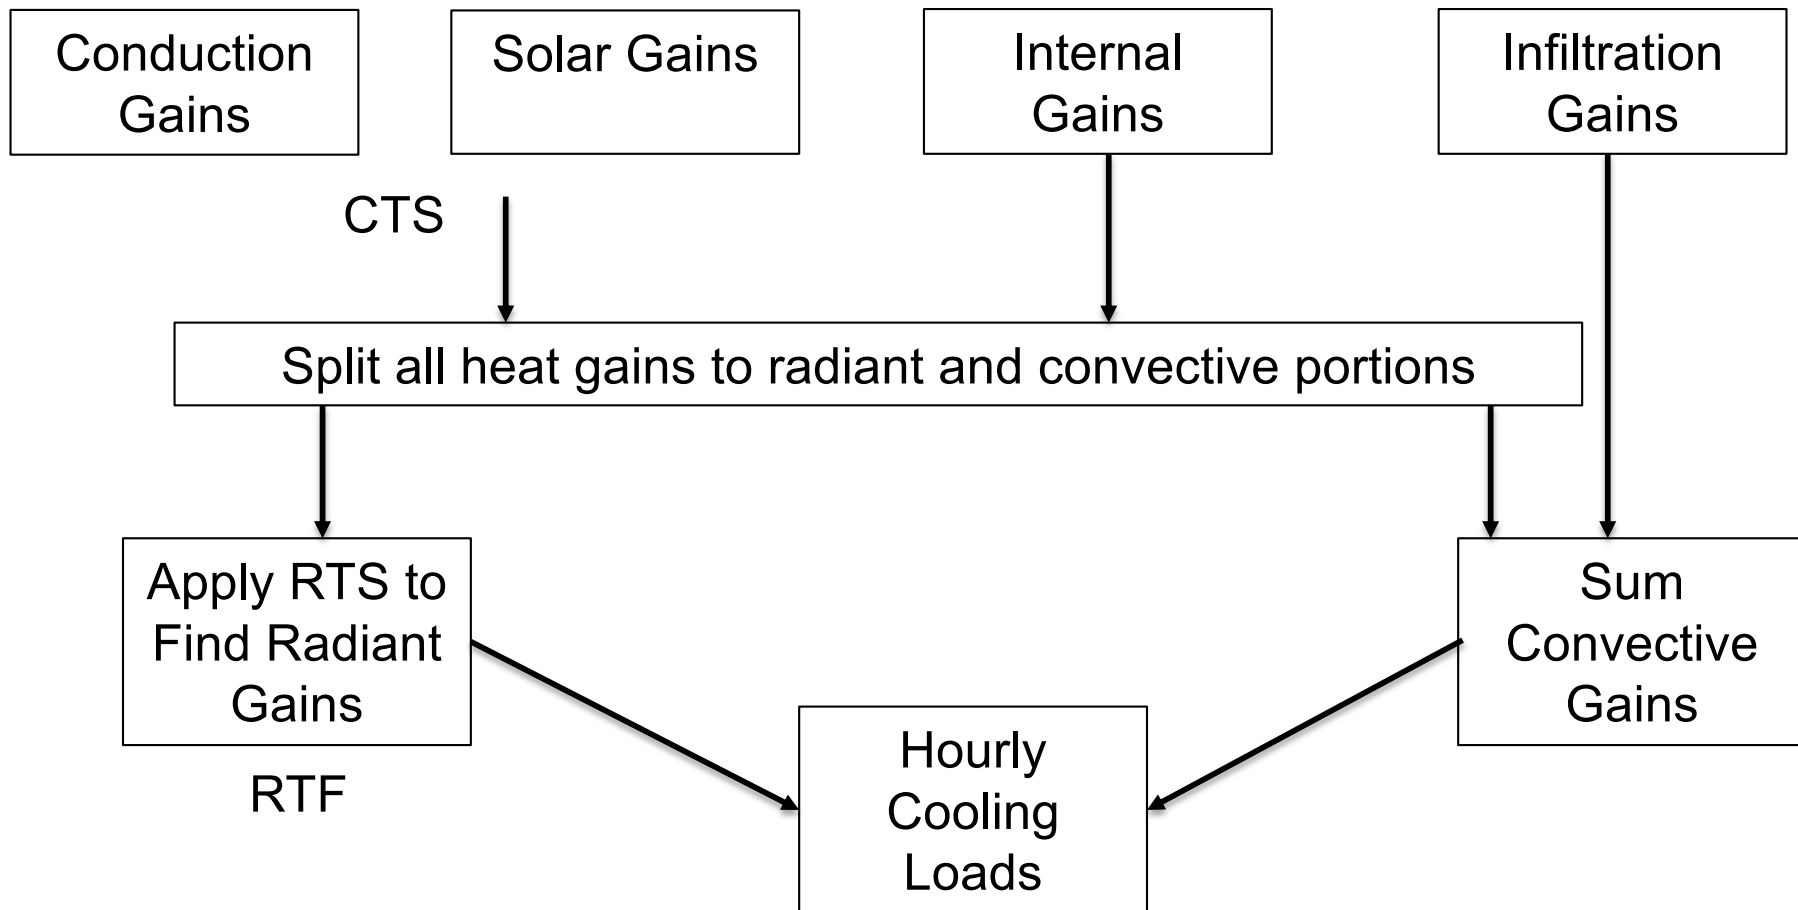

CTS = Conduction Transfer Series

RTF = Radiant Transfer Function

Recap

Table 14 Recommended Radiative/Convective Splits for Internal Heat Gains

Heat Gain Type	Recommended Radiative Fraction	Recommended Convective Fraction	Comments
Occupants, typical office conditions	0.60	0.40	See Table 1 for other conditions.
Equipment	0.1 to 0.8	0.9 to 0.2	See Tables 6 to 12 for details of equipment heat gain and recommended radiative/convective splits for motors, cooking appliances, laboratory equipment, medical equipment, office equipment, etc.
Office, with fan	0.10	0.90	
Without fan	0.30	0.70	
Lighting			Varies; see Table 3 .
Conduction heat gain			
Through walls and floors	0.46	0.54	
Through roof	0.60	0.40	
Through windows	0.33 (SHGC > 0.5) 0.46 (SHGC < 0.5)	0.67 (SHGC > 0.5) 0.54 (SHGC < 0.5)	
Solar heat gain through fenestration			
Without interior shading	1.00	0.00	
With interior shading			Varies; see Tables 14A to 14G in Chapter 15 .
Infiltration	0.00	1.00	

Source: Nigusse (2007).

Recap

$$q_{\theta} = \sum_{j=0}^{23} c_j UA(t_{sol-air,\theta-j\delta} - t_{rc})$$

Recap

Recap

- Comparison between different wall assemblies:

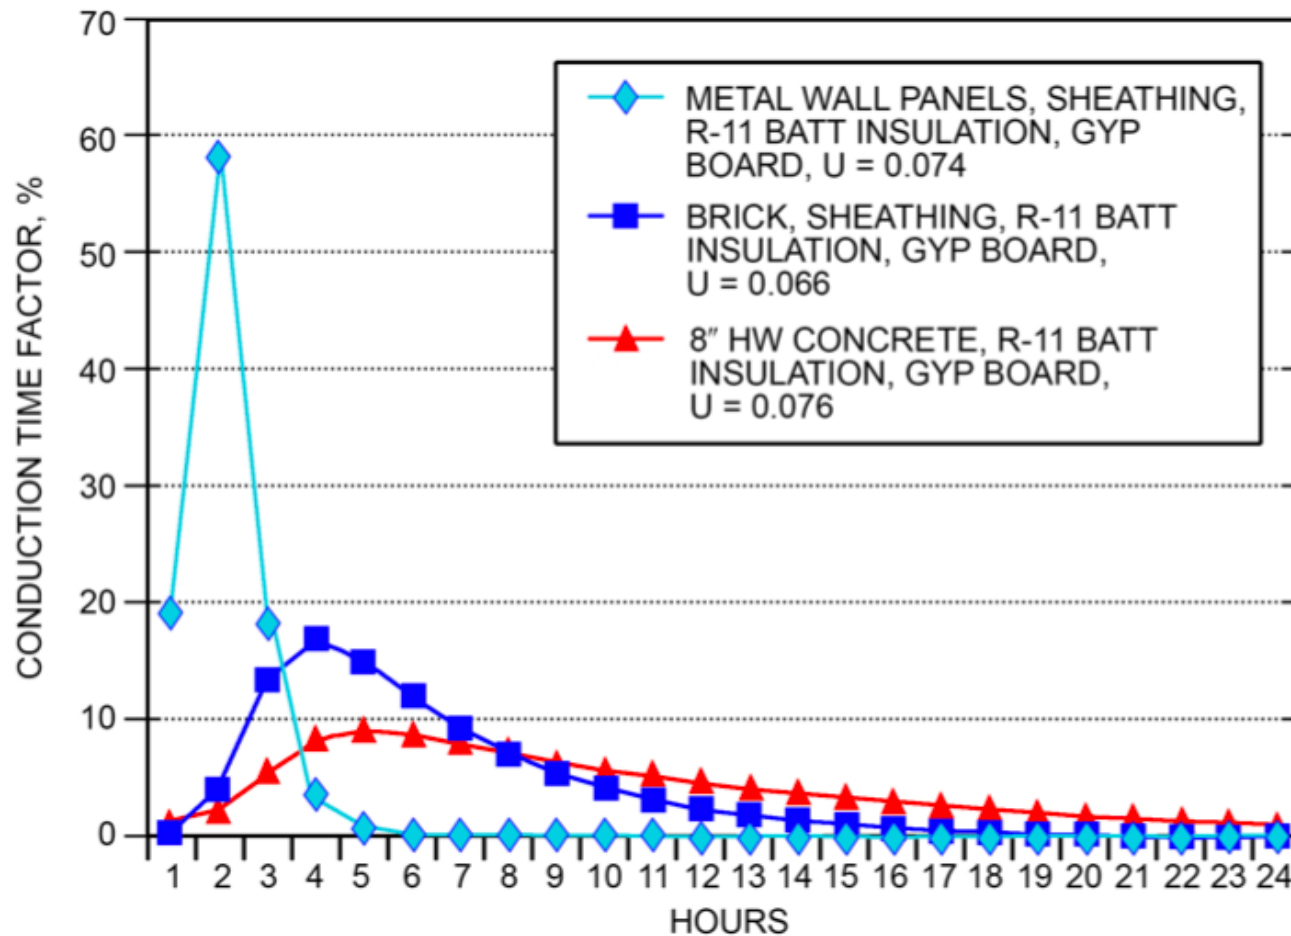


Fig. 9 CTS for Light to Heavy Walls

Recap

Table 16 Wall Conduction Time Series (CTS) (Continued)

	Brick Walls								
	Brick, R-5 Insulation Board, Sheathing, Gyp. Board	Brick, R-10 Insulation Board, Sheathing, Gyp. Board	Brick, Sheathing, R-11 Batt Insulation, Gyp. Board	Brick, Sheathing, R-22 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, Sheathing, R-11 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, Sheathing, R-22 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, 8 in. LW CMU	Brick, R-10 Insulation Board, 8 in. LW CMU	Brick, 8 in. LW CMU, R-11 Batt Insulation, Gyp. Board
Wall Number	21	22	23	24	25	26	27	28	29
<i>U</i> , Btu/h·ft ² ·°F	0.101	0.067	0.066	0.038	0.050	0.028	0.103	0.068	0.061
Total <i>R</i>	9.9	14.9	15.1	26.1	20.1	36.1	9.7	14.7	16.4
Hour	Conduction Time Factors, %								
0	0.2	0.1	0.2	0.1	0.1	0.4	0.6	0.8	1.6
1	4.8	3.0	4.1	1.6	1.5	0.5	0.8	0.8	1.5
2	13.9	11.1	13.3	8.5	6.8	2.0	2.6	2.1	1.9
3	16.7	15.5	16.6	14.5	11.7	5.3	5.5	4.5	3.3
4	14.9	15.0	14.8	15.2	13.3	8.2	7.6	6.6	5.0
5	12.0	12.7	11.8	13.1	12.7	9.7	8.7	7.9	6.2
6	9.2	10.1	9.2	10.6	11.1	10.1	9.0	8.4	6.9
7	7.0	7.8	7.1	8.3	9.2	9.6	8.7	8.4	7.1
8	5.3	6.0	5.4	6.5	7.5	8.8	8.2	8.0	7.0
9	4.0	4.6	4.2	5.0	5.9	7.8	7.4	7.4	6.7
10	3.0	3.5	3.2	3.9	4.7	6.8	6.6	6.7	6.3
11	2.3	2.6	2.4	3.0	3.6	5.8	5.8	6.0	5.9
12	1.7	2.0	1.9	2.3	2.8	4.9	5.0	5.3	5.4
13	1.3	1.5	1.4	1.8	2.2	4.1	4.3	4.7	5.0
14	1.0	1.1	1.1	1.4	1.7	3.4	3.7	4.1	4.5
15	0.7	0.9	0.8	1.1	1.3	2.8	3.1	3.5	4.1
16	0.5	0.7	0.6	0.8	1.0	2.3	2.6	3.0	3.7
17	0.4	0.5	0.5	0.6	0.8	1.9	2.2	2.6	3.4
18	0.3	0.4	0.4	0.5	0.6	1.5	1.9	2.2	3.0
19	0.2	0.3	0.3	0.4	0.5	1.2	1.6	1.9	2.7
20	0.2	0.2	0.2	0.3	0.4	1.0	1.3	1.6	2.5
21	0.1	0.2	0.2	0.2	0.3	0.8	1.1	1.4	2.2
22	0.1	0.1	0.1	0.2	0.2	0.6	0.9	1.1	2.0
23	0.1	0.1	0.1	0.1	0.2	0.5	0.7	1.0	1.8
Total Percentage	100	100	100	100	100	100	100	100	100
Layer ID from outdoors to indoors (See Table 18)	F01 M01 F04 I01 G03 F04 G01 F02 0 0	F01 M01 F04 I01 G03 G03 F04 G01 F02 0 F02 0 0	F01 M01 F04 G03 I04 G01 F02 0 0 0	F01 M01 F04 G03 I04 G01 F02 0 0 0	F01 M01 F04 I01 G03 I04 G01 F02 0 0 0	F01 M01 F04 I01 G03 G03 F02 I04 G01 F02 0 F02 0	F01 M01 F04 I01 M03 F02 0 0 0 0	F01 M01 F04 I01 I01 M03 F02 0 0 0 0	F01 M01 F04 M03 I04 G01 F02 0 0 0 0

Recap

$$Q_{\theta} = r_0 q_{\theta} + r_1 q_{\theta-\delta} + r_2 q_{\theta-2\delta} + \dots + r_{23} q_{\theta-23\delta}$$

- ❑ Q_{θ} : Cooling load for the current hour θ
- ❑ q_{θ} : Heat gain for the current hour
- ❑ $q_{\theta-n\delta}$: Heat gain n hours ago
- ❑ r_0, r_1, \dots : RTFs

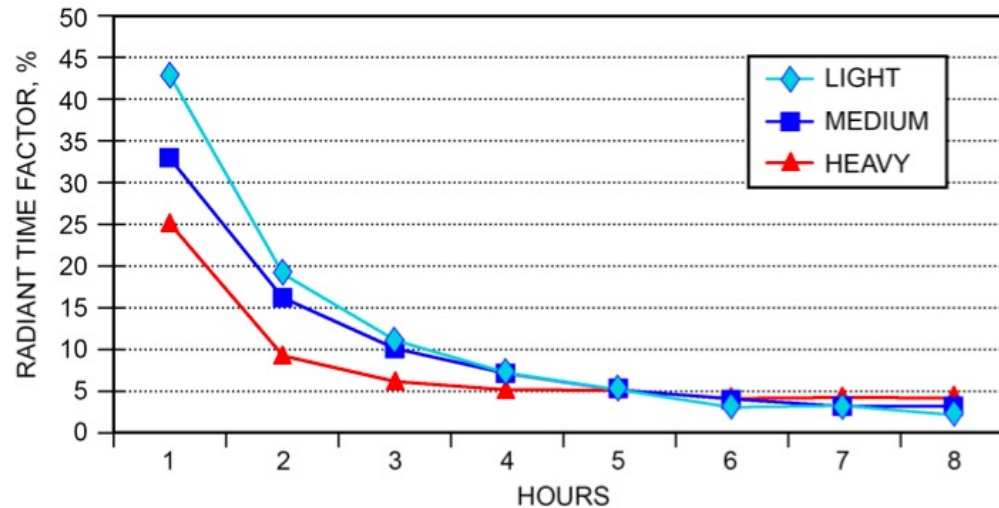


Fig. 11 RTS for Light to Heavy Construction

Recap

Table 19 Representative Nonsolar RTS Values for Light to Heavy Construction

% Glass	Interior Zones																		With Carpet	No Carpet	With Carpet	No Carpet	With Carpet	No Carpet
	Light						Medium						Heavy											
	With Carpet			No Carpet			With Carpet			No Carpet			With Carpet			No Carpet								
	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%						
Hour	Radiant Time Factor, %																							
0	47	50	53	41	43	46	46	49	52	31	33	35	34	38	42	22	25	28	46	40	46	31	33	21
1	19	18	17	20	19	19	18	17	16	17	16	15	9	9	9	10	9	9	19	20	18	17	9	9
2	11	10	9	12	11	11	10	9	8	11	10	10	6	6	5	6	6	6	11	12	10	11	6	6
3	6	6	5	8	7	7	6	5	5	8	7	7	4	4	4	5	5	5	6	8	6	8	5	5
4	4	4	3	5	5	5	4	3	3	6	5	5	4	4	4	5	5	4	4	5	3	6	4	5
5	3	3	2	4	3	3	2	2	2	4	4	4	4	3	3	4	4	4	3	4	2	4	4	4
6	2	2	2	3	3	2	2	2	2	4	3	3	3	3	3	4	4	4	2	3	2	4	3	4
7	2	1	1	2	2	2	1	1	1	3	3	3	3	3	3	4	4	4	2	2	1	3	3	4
8	1	1	1	1	1	1	1	1	1	3	2	2	3	3	3	4	3	3	1	1	1	3	3	4
9	1	1	1	1	1	1	1	1	1	2	2	2	3	3	2	3	3	3	1	1	1	2	3	3
10	1	1	1	1	1	1	1	1	1	2	2	2	3	2	2	3	3	3	1	1	1	2	3	3
11	1	1	1	1	1	1	1	1	1	2	2	2	2	2	2	3	3	3	1	1	1	2	2	3
12	1	1	1	1	1	1	1	1	1	1	1	1	2	2	2	3	3	3	1	1	1	1	2	3
13	1	1	1	0	1	0	1	1	1	1	1	1	2	2	2	3	3	2	1	1	1	1	2	3
14	0	0	1	0	1	0	1	1	1	1	1	1	2	2	2	3	2	2	1	0	1	1	2	3
15	0	0	1	0	0	0	1	1	1	1	1	1	2	2	2	2	2	2	0	0	1	1	2	3
16	0	0	0	0	0	0	1	1	1	1	1	1	2	2	2	2	2	2	0	0	1	1	2	3
17	0	0	0	0	0	0	1	1	1	1	1	1	2	2	2	2	2	2	0	0	1	1	2	2
18	0	0	0	0	0	0	1	1	1	1	1	1	2	2	1	2	2	2	0	0	1	1	2	2
19	0	0	0	0	0	0	0	1	0	0	1	1	2	2	1	2	2	2	0	0	1	0	2	2
20	0	0	0	0	0	0	0	0	0	0	1	1	2	1	1	2	2	2	0	0	0	0	2	2
21	0	0	0	0	0	0	0	0	0	0	1	1	2	1	1	2	2	2	0	0	0	0	2	2
22	0	0	0	0	0	0	0	0	0	0	1	0	1	1	1	2	2	2	0	0	0	0	1	2
23	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	2	2	1	0	0	0	0	1	2
	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100

Recap

EXAMPLE (LIGHTING FIXTURES)


Example (Lighting Fixture)

Example: An interior zone with florescent lighting fixture has a power use of 1000 W. Calculate:

- The percentage of radiant and convective parts.
- The associated load at 2 pm?

Internal Loads (Lighting)

- Radiant Transfer Series Method (RTSM)

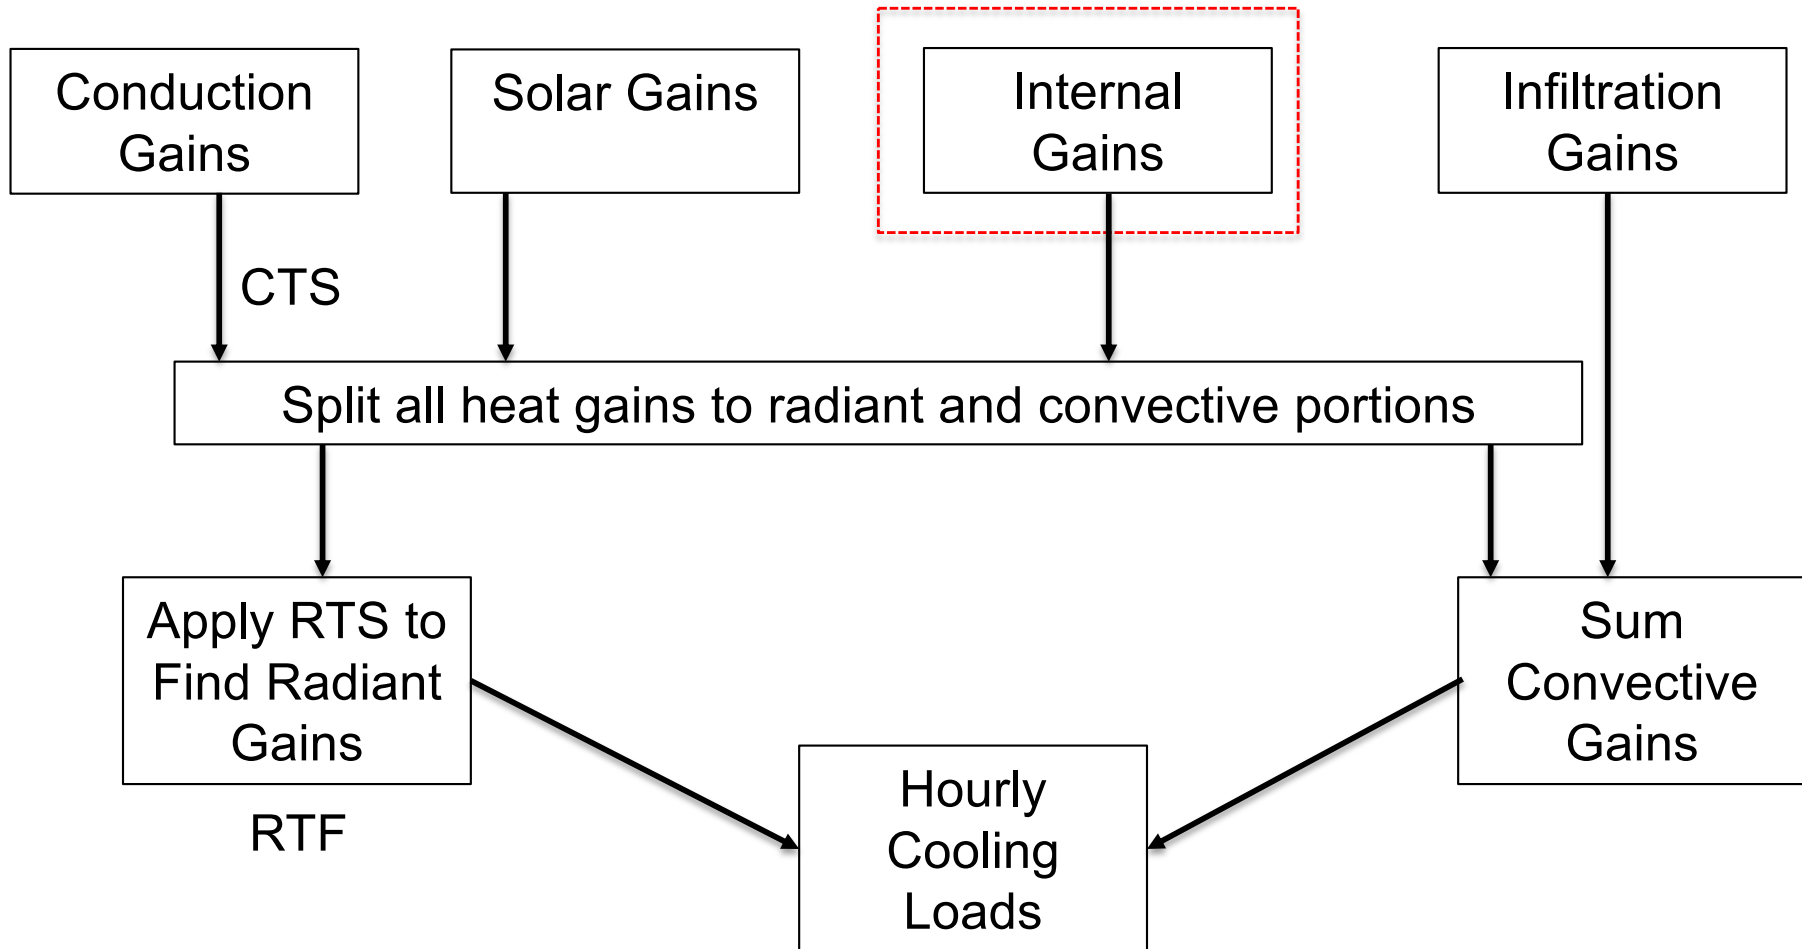

CTS = Conduction Transfer Series

RTF = Radiant Transfer Function

Example (Lighting Fixture)

Solution: Method 1:

f_{rad}


Table 3 Lighting Heat Gain Parameters for Typical Operating Conditions

Luminaire Category	Space Fraction	Radiative Fraction	Notes
Recessed fluorescent luminaire without lens	0.64 to 0.74	0.48 to 0.68	<ul style="list-style-type: none"> • Use middle values in most situations • May use higher space fraction, and lower radiative fraction for luminaire with side-slot returns • May use lower values of both fractions for direct/indirect luminaire • May use higher values of both fractions for ducted returns
Recessed fluorescent luminaire with lens	0.40 to 0.50	0.61 to 0.73	<ul style="list-style-type: none"> • May adjust values in the same way as for recessed fluorescent luminaire without lens
Downlight compact fluorescent luminaire	0.12 to 0.24	0.95 to 1.0	<ul style="list-style-type: none"> • Use middle or high values if detailed features are unknown • Use low value for space fraction and high value for radiative fraction if there are large holes in luminaire's reflector
Downlight incandescent luminaire	0.70 to 0.80	0.95 to 1.0	<ul style="list-style-type: none"> • Use middle values if lamp type is unknown • Use low value for space fraction if standard lamp (i.e. A-lamp) is used • Use high value for space fraction if reflector lamp (i.e. BR-lamp) is used
Non-in-ceiling fluorescent luminaire	1.0	0.5 to 0.57	<ul style="list-style-type: none"> • Use lower value for radiative fraction for surface-mounted luminaire • Use higher value for radiative fraction for pendant luminaire

$$f_{conv} = 1 - f_{rad}$$

Example (Lighting Fixture)

Solution: Method 2:

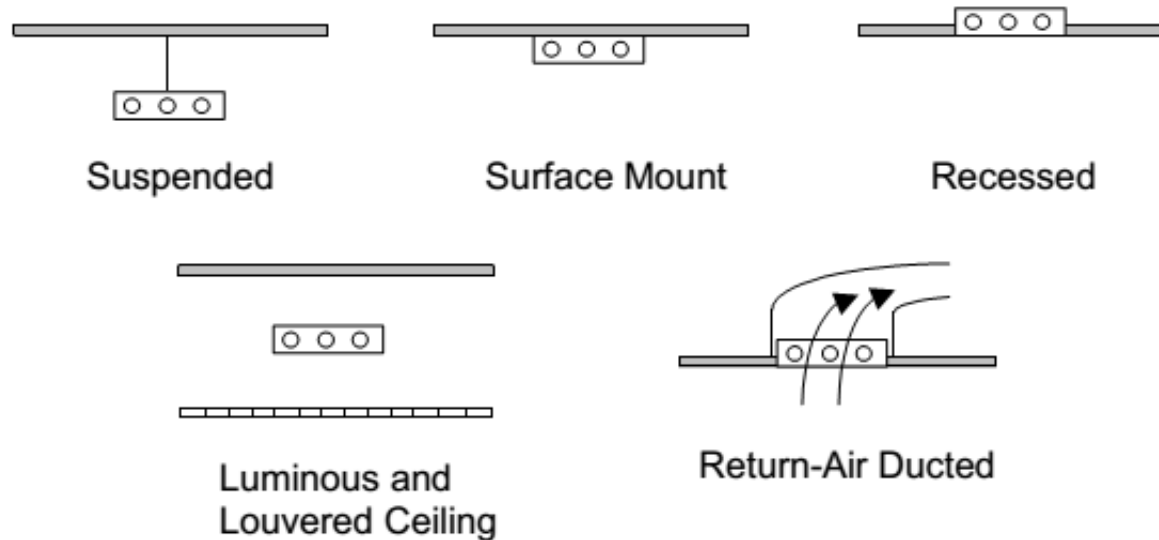

Field Name	Luminaire Configuration, Fluorescent Lighting				
	Suspended	Surface mount	Recessed	Luminous and louvered ceiling	Return-air ducted
Return Fraction Air	0.0	0.0	0.0	0.0	0.54
Fraction Radiant	0.42	0.72	0.37	0.37	0.18
Fraction Visible	0.18	0.18	0.18	0.18	0.18
$f_{convected}$	0.40	0.10	0.45	0.45	0.10

f_{rad}

f_{conv}

Example (Lighting Fixture)

Table 19 Representative Nonsolar RTS Values for Light to Heavy Construction

% Glass	Radiant Time Factor, %																		Interior Zones						
	Light						Medium						Heavy						Light		Medium		Heavy		
	With Carpet			No Carpet			With Carpet			No Carpet			With Carpet			No Carpet			With Carpet	No Carpet	With Carpet	No Carpet	With Carpet	No Carpet	
	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	10%	50%	90%	
Hour	0	47	50	53	41	43	46	46	49	52	31	33	35	34	38	42	22	25	28	46	40	46	31	33	21
1	19	18	17	20	19	19	18	17	16	17	16	15	9	9	9	10	9	9	9	19	20	18	17	9	9
2	11	10	9	12	11	11	10	9	8	11	10	10	6	6	5	6	6	6	6	11	12	10	11	6	6
3	6	6	5	8	7	7	6	5	5	8	7	7	4	4	4	5	5	5	5	6	8	6	8	5	5
4	4	4	3	5	5	5	4	3	3	6	5	5	4	4	4	5	5	4	4	4	5	3	6	4	5
5	3	3	2	4	3	3	2	2	2	4	4	4	4	3	3	4	4	4	4	3	4	2	4	4	4
6	2	2	2	3	3	2	2	2	2	4	3	3	3	3	3	4	4	4	4	2	3	2	4	3	4
7	2	1	1	2	2	2	1	1	1	3	3	3	3	3	3	4	4	4	4	2	2	1	3	3	4
8	1	1	1	1	1	1	1	1	1	3	2	2	3	3	3	4	3	3	3	1	1	1	3	3	4
9	1	1	1	1	1	1	1	1	1	2	2	2	3	3	2	3	3	3	3	1	1	1	2	3	3
10	1	1	1	1	1	1	1	1	1	2	2	2	3	2	2	3	3	3	3	1	1	1	2	3	3
11	1	1	1	1	1	1	1	1	1	2	2	2	2	2	2	3	3	3	3	1	1	1	2	2	3
12	1	1	1	1	1	1	1	1	1	1	1	1	2	2	2	3	3	3	3	1	1	1	1	2	3
13	1	1	1	0	1	0	1	1	1	1	1	1	2	2	2	3	3	2	2	1	1	1	1	2	3
14	0	0	1	0	1	0	1	1	1	1	1	1	2	2	2	3	2	2	2	1	0	1	1	2	3
15	0	0	1	0	0	0	1	1	1	1	1	1	2	2	2	2	2	2	2	0	0	1	1	2	3
16	0	0	0	0	0	0	1	1	1	1	1	1	2	2	2	2	2	2	2	0	0	1	1	2	3
17	0	0	0	0	0	0	1	1	1	1	1	1	2	2	2	2	2	2	2	0	0	1	1	2	2
18	0	0	0	0	0	0	1	1	1	1	1	1	2	2	1	2	2	2	2	0	0	1	1	2	2
19	0	0	0	0	0	0	0	1	0	0	1	1	2	2	1	2	2	2	2	0	0	1	0	2	2
20	0	0	0	0	0	0	0	0	0	0	1	1	2	1	1	2	2	2	2	0	0	0	0	2	2
21	0	0	0	0	0	0	0	0	0	0	1	1	2	1	1	2	2	2	2	0	0	0	0	2	2
22	0	0	0	0	0	0	0	0	0	0	1	0	1	1	1	2	2	2	2	0	0	0	0	1	2
23	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	2	2	1	1	0	0	0	0	1	2
	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100

Example (Lighting Fixture)

$$Q_{14} = Q_{14,radiative} + Q_{14,convective}$$

$$Q_{14,radiative} = f_{rad} \times [r_0 q_{14} + r_1 q_{14-1} + r_2 q_{14-2} + \dots + r_{23} q_{14-23}]$$

$$Q_{14,radiative} = f_{rad} \times [r_0 q_{14} + r_1 q_{13} + r_2 q_{12} + \dots + r_{23} q_{15}]$$

Example (Lighting Fixture)

- Let's complete this table together ...

Hour	r_θ	q_θ	f_{rad}	$q_{\theta,rad}$

Example (Lighting Fixture)

$$Q_{14,convective} = f_{conv} \times q_{14,conv} = 0.4 \times 1000 \text{ W} = 400 \text{ W}$$

$$Q_{14,radiative} = (0.42) \times [(0.46)(1000 \text{ W}) + (0.19)(1000 \text{ W}) + \dots + (0)(0.42)(1000 \text{ W})] = 420 \text{ W}$$

Did we really need to write the series?

Try to solve this exam using a schedule for the lighting fixtures

Example (Lighting Fixture)

- Solve this exam using a schedule for the lighting fixtures

Hour	r_{θ}	q_{θ}	f_{rad}	$q_{\theta,rad}$

EXAMPLE (HEATING LOAD)

Example (Heating Load)

Example: Calculate the room heating load for a top floor with the following information:

- The location is Chicago
- Roof area is 100 ft²
- Each wall area is 50 ft²
- Window area on each wall is 25 ft²
- Room height is 9 ft
- Infiltration rate is 1 ACH
- Roof U-value is 0.0799 Btu/h-ft²-°F
- Windows U-value is 0.5 Btu/h-ft²-°F
- The wall assembly entails: 4" brick, wall air space resistance, R-5 1" insulation board, 8" LW concrete block

Example (Heating Load)

Solution:

- Find the outdoor design condition using Chapter 14

Station	Lat	Long	Elev	Heating DB		Cooling DB/MCWB			Evaporation WB/MCDB		Dehumidification DP/HR/MCDB		Extreme Annual WS			Heat./Cool. Degree-Days										
						0.4%	1%	2%	0.4%	1%	0.4%	1%	1%	2.5%	5%	HDD / CDD 65										
				99.6%	99%	DB / MCWB	DB / MCWB	DB / MCWB	WB / MCDB	WB / MCDB	DP / HR / MCDB	DP / HR / MCDB	1%	2.5%	5%	HDD / CDD 65										
SW GEORGIA REGIONAL	31.536N	84.194W	190	26.6	29.6	96.8	75.9	94.7	75.7	92.7	75.4	79.7	90.4	78.5	88.8	77.2	142.4	83.1	75.9	136.4	82.2	18.4	16.4	14.2	1746	2547
VALDOSTA REGIONAL	30.783N	83.277W	198	27.7	30.8	96.6	76.6	94.5	76.2	92.7	75.8	80.2	90.0	79.2	88.8	77.6	144.6	83.1	76.9	141.1	82.5	16.5	14.0	12.4	1477	2627
Hawaii																										
HILO INTL	19.719N	155.053W	38	61.6	62.8	85.7	74.0	84.7	73.7	83.9	73.4	76.5	82.0	75.8	81.5	75.0	131.5	79.2	74.0	127.2	78.5	16.7	14.9	12.8	0	3245
HONOLULU INTL	21.324N	157.929W	7	62.5	64.5	89.4	73.8	88.5	73.4	87.7	73.0	77.1	84.5	76.2	83.8	74.9	130.9	81.0	73.7	125.6	80.3	22.5	20.4	18.9	0	4656
KALAELOA	21.317N	158.067W	33	60.4	62.5	90.1	73.4	88.8	73.2	87.9	73.0	77.4	84.9	76.3	84.2	75.1	131.9	81.5	73.5	124.7	80.5	18.2	16.4	14.7	0	4214
KANEOHE MCAS	21.450N	157.768W	24	64.0	65.9	84.9	74.3	84.1	74.1	83.4	73.8	77.0	81.6	76.1	81.3	75.3	132.9	79.8	74.3	128.5	79.5	18.5	16.7	15.4	0	4190
Idaho																										
BOISE AP	43.567N	116.241W	2814	9.4	15.9	98.6	63.8	95.7	62.8	92.8	61.9	66.1	92.0	64.7	90.2	57.5	78.3	71.5	55.1	71.8	71.6	22.0	19.1	17.1	5414	1007
CALDWELL INDUSTRIAL AP	43.650N	116.633W	2429	9.6	15.7	97.0	66.2	93.1	64.7	90.6	63.8	68.2	92.3	66.4	90.0	59.1	82.0	78.5	56.7	75.0	77.6	22.1	19.2	17.0	5739	692
COEUR D'ALENE AP	47.767N	116.817W	2307	5.8	10.4	91.3	63.1	88.5	62.6	84.2	61.1	66.3	85.6	64.3	83.4	59.2	81.7	72.0	56.8	75.0	70.6	22.3	18.9	16.8	6875	316
IDAHO FALLS REGIONAL	43.516N	112.067W	4729	-6.6	-0.3	92.1	60.9	89.6	60.5	86.7	59.6	64.7	83.2	63.0	81.9	58.7	87.9	71.0	56.2	80.3	68.9	27.2	24.3	20.7	7672	288
LEWISTON-NEZ PERCE CO REGL	46.375N	117.016W	1436	13.0	18.8	98.5	65.3	95.0	64.5	91.4	63.2	67.8	91.9	66.1	89.8	60.0	81.6	72.7	57.7	75.1	72.0	20.9	17.9	15.1	5044	868
MAGIC VALLEY REGIONAL	42.482N	114.487W	4151	7.6	12.0	95.0	62.6	92.2	62.1	89.8	61.6	66.3	88.7	64.7	86.1	58.8	86.4	74.6	56.6	79.6	74.2	27.9	24.6	20.9	6029	775
POCATELLO REGIONAL	42.920N	112.571W	4452	-2.0	3.8	94.9	61.4	91.8	60.8	88.8	60.0	65.2	86.3	63.5	84.5	58.7	86.9	70.7	55.8	78.2	70.5	28.6	25.5	22.6	6941	440
Illinois																										
ABRAHAM LINCOLN CAPITAL	39.845N	89.684W	594	1.1	6.9	92.6	76.7	90.4	75.6	88.0	74.1	79.5	89.5	77.9	87.3	76.5	141.4	86.2	75.0	134.3	84.3	24.7	21.4	19.1	5328	1144
AURORA MUNICIPAL	41.770N	88.481W	710	-4.9	0.7	90.7	74.1	88.2	73.2	85.5	72.0	77.7	87.1	76.0	84.3	74.8	134.0	83.4	73.1	126.2	81.3	26.0	23.0	19.9	6537	729
CHICAGO MIDWAY INTL	41.786N	87.752W	612	0.5	6.1	91.9	74.7	89.4	73.1	86.6	72.0	77.8	87.8	76.0	85.3	74.9	133.6	84.0	72.9	125.0	82.0	24.4	21.0	19.1	5850	1057
CHICAGO OHARE INTL	41.995N	87.934W	662	-1.0	4.4	91.3	74.2	88.5	72.9	85.9	71.6	77.5	87.3	75.7	84.7	74.5	132.2	83.5	72.8	124.7	81.4	24.6	21.0	19.1	6190	882
CHICAGO ROCKFORD INTL	42.193N	89.093W	730	-5.4	0.3	90.9	74.4	88.0	72.9	85.4	71.6	77.8	87.0	75.8	84.0	75.0	134.8	83.3	73.2	126.5	81.7	24.5	20.9	18.9	6589	786
DECATUR AP	39.834N	88.866W	675	1.9	7.3	93.1	76.6	90.7	75.5	88.3	74.3	79.4	89.4	77.8	87.5	76.4	141.5	86.0	74.9	134.0	84.1	24.7	21.5	19.6	5388	1105
DUPAGE COUNT AP	41.914N	88.246W	754	-2.5	2.6	90.2	74.6	87.8	73.5	84.6	71.8	77.9	86.8	76.0	84.0	75.0	135.1	83.8	73.1	126.6	81.5	24.8	21.6	19.3	6430	750
GLENVIEW NAS	42.083N	87.817W	653	-0.7	4.8	93.7	75.0	90.2	73.3	87.1	72.1	77.9	90.2	76.2	87.0	74.2	130.7	85.1	72.4	123.1	83.6	20.2	18.0	16.2	6104	909
GREATER PEORIA REGIONAL	40.668N	89.684W	650	-0.9	4.3	92.0	76.5	89.6	75.2	87.0	73.6	79.3	88.3	77.5	86.5	76.6	142.1	85.3	74.8	133.7	83.2	23.1	19.7	17.8	5733	1057
QUAD CITY INTL	41.465N	90.523W	592	-3.5	1.8	92.4	76.2	89.7	74.9	87.1	73.2	79.1	88.8	77.4	86.5	76.3	140.5	85.3	74.6	132.4	83.2	23.9	20.2	18.2	6091	988
QUINCY REGIONAL	39.937N	91.192W	769	0.4	5.6	93.1	76.5	90.3	75.4	87.7	74.1	78.9	89.1	77.5	87.1	76.0	139.6	85.3	74.4	132.3	83.6	24.3	20.7	18.7	5497	1119
SCOTT AFB	38.550N	89.850W	459	7.2	12.1	95.2	77.7	92.7	76.9	90.3	75.9	80.7	90.2	79.2	88.6	78.1	148.5	85.8	76.7	141.4	84.5	22.7	19.6	17.5	4617	1413
ST LOUIS DOWNTOWN AP	38.571N	90.157W	413	8.6	12.7	95.4	76.6	92.7	76.3	90.4	75.2	79.9	90.5	78.3	88.9	77.0	142.9	85.4	75.1	133.9	83.9	20.8	18.6	16.6	4569	1432
U OF ILLINOIS WILLARD AP	40.040N	88.278W	754	-0.4	4.9	91.4	75.5	89.6	74.8	86.9	73.4	79.2	87.8	77.4	85.9	76.7	143.1	85.1	74.8	134.2	82.7	27.5	24.6	21.4	5693	973

Example (Heating Load)


- Find the wall U-value

Table 16 Wall Conduction Time Series (CTS) (Continued)

	Brick Walls								
	Brick, R-5 Insulation Board, Sheathing, Gyp. Board	Brick, R-10 Insulation Board, Sheathing, Gyp. Board	Brick, Sheathing, R-11 Batt Insulation, Gyp. Board	Brick, Sheathing, R-22 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, Sheathing, R-11 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, Sheathing, R-22 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, 8 in. LW CMU	Brick, R-10 Insulation Board, 8 in. LW CMU	Brick, 8 in. LW CMU, R-11 Batt Insulation, Gyp. Board
Wall Number	21	22	23	24	25	26	27	28	29
U , Btu/h·ft ² ·°F	0.101	0.067	0.066	0.038	0.050	0.028	0.103	0.068	0.061
Total R	9.9	14.9	15.1	26.1	20.1	36.1	9.7	14.7	16.4
							F01		
							M01		
							F04		
							I01		
							M03		
							F02		
							0		
							0		
							0		
							0		

Example (Heating Load)

- Understand the heat load calculation components:

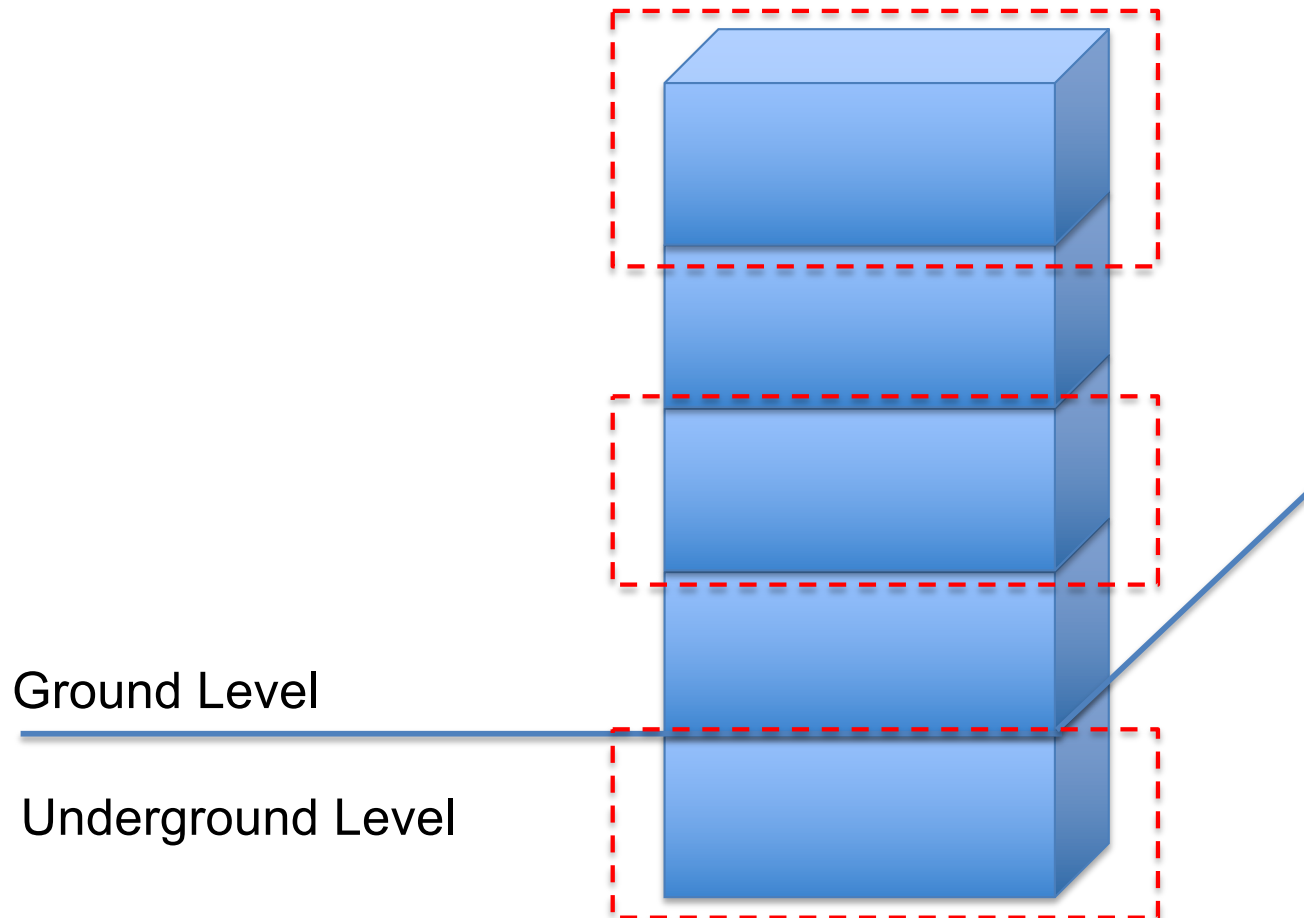

Example (Heating Load)

- Calculate the enclosure heat transfer:

$$\begin{aligned} Q_{wall} &= U_{wall} \times A_{wall} \times (t_{room} - t_{99.6\%}) \\ &= (0.103)(4 \times 50) \times (72 - (-1)) = 1503.8 \frac{Btu}{h} \end{aligned}$$

$$\begin{aligned} Q_{win} &= U_{win} \times A_{win} \times (t_{room} - t_{99.6\%}) \\ &= (0.5) \times (4 \times 25) \times (72 - (-1)) = 7300 \frac{Btu}{h} \end{aligned}$$

$$\begin{aligned} Q_{roof} &= U_{roof} \times A_{roof} \times (t_{room} - t_{99.6\%}) \\ &= (0.0799) \times (100) \times (72 - (-1)) = 583.27 \frac{Btu}{hr} \end{aligned}$$

Example (Heating Load)

- Calculate the infiltration rate:

$$Q_{infiltration} = q_s = 1.1 \times Q_s \times (t_{room} - t_{99.6\%})$$

$$Infiltration\ rate = \frac{Volume \times ACH}{60} = \frac{100\ ft^2 \times 9 \times 1}{60} = 15\ cfm$$

$$Q_{infiltration} = 1.1 \times 15 \times (72 - (-1)) = 1204.5 \frac{Btu}{hr}$$

Example (Heating Load)

- Sum all the heat loads:

$$Q_{total} = Q_{wall} + Q_{win} + Q_{roof} + Q_{infiltration}$$

$$Q_{total} = 1503.8 + 7300 + 583.27 + 1204.5 = 10591.57 \frac{Btu}{hr}$$

EXAMPLE (BUILDING ENCLOSURE)


Example (Building Enclosure)

Example: Calculate the radiative and convective cooling load for a south facing wall at 4 pm with the following information

- The location is Chicago
- Wall area is 1000 ft²
- Wall assembly is Wall #38

Example (Building Enclosure)

- Solution:

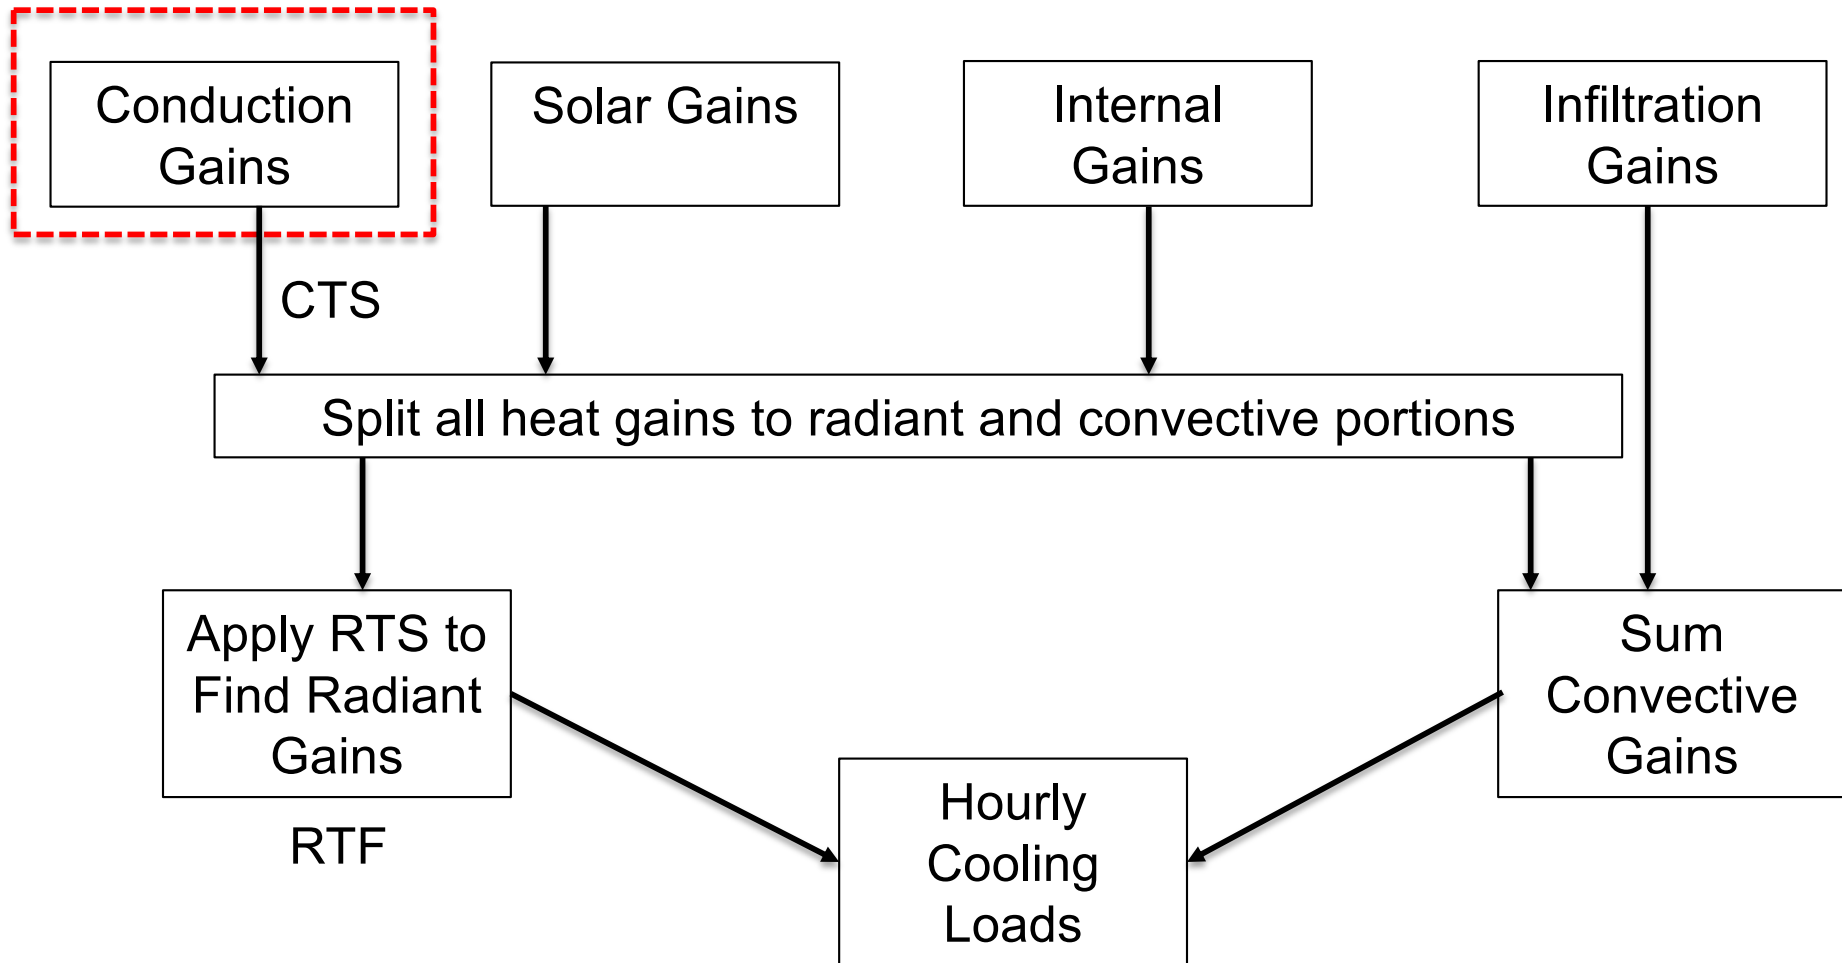

CTS = Conduction Transfer Series

RTF = Radiant Transfer Function

Example (Building Enclosure)

Sol-Air Temperature (°F) for July 21, 41.79°N Latitude, 87.75°W Longitude, Time Zone: NAC Daylight Savings Time											
USA - IL - CHICAGO/MIDWAY, 0.4% Design Condition, Surface Color: alpha/ho = 0.3											
Local Time	Air Temp.	N	NE	E	SE	S	SW	W	NW	Horiz	
1.0	81.9	81.9	81.9	81.9	81.9	81.9	81.9	81.9	81.9	74.9	
2.0	80.8	80.8	80.8	80.8	80.8	80.8	80.8	80.8	80.8	73.8	
3.0	80.1	80.1	80.1	80.1	80.1	80.1	80.1	80.1	80.1	73.1	
4.0	79.5	79.5	79.5	79.5	79.5	79.5	79.5	79.5	79.5	72.5	
5.0	78.9	78.9	78.9	78.9	78.9	78.9	78.9	78.9	78.9	71.9	
6.0	78.6	84.3	89.9	89.6	83.5	79.8	79.8	79.8	79.8	74.2	
7.0	79.0	94.9	121.5	125.9	105.0	83.1	83.1	83.1	83.1	87.7	
8.0	80.4	94.2	133.4	146.5	124.7	88.0	87.5	87.5	87.5	106.6	
9.0	83.7	94.2	134.1	155.4	140.2	98.5	93.4	93.4	93.4	127.6	
10.0	87.2	99.5	127.3	154.2	149.0	115.2	99.2	99.2	99.2	147.0	
11.0	90.4	104.0	115.8	144.6	150.3	129.2	104.6	104.0	104.0	162.4	
12.0	93.2	107.8	108.7	129.3	144.8	139.1	115.9	107.8	107.8	172.9	
13.0	95.0	109.9	109.9	111.2	133.0	143.2	134.5	112.3	109.9	177.2	
14.0	96.5	111.0	111.0	111.0	117.5	142.0	149.2	134.5	112.0	175.7	
15.0	97.4	110.9	110.9	110.9	111.4	135.3	157.8	153.1	124.4	168.4	
16.0	97.4	109.5	109.1	109.1	109.1	124.1	159.0	165.2	138.7	155.7	
17.0	96.2	106.5	105.7	105.7	105.7	109.7	151.8	167.9	147.3	138.5	
18.0	94.7	109.0	101.5	101.5	101.5	102.0	137.5	159.6	147.4	119.1	
19.0	92.8	108.3	96.6	96.6	96.6	96.6	116.7	136.8	133.2	99.9	
20.0	89.9	93.9	90.9	90.9	90.9	90.9	93.3	97.3	97.6	84.8	
21.0	87.9	87.9	87.9	87.9	87.9	87.9	87.9	87.9	87.9	80.9	
22.0	86.2	86.2	86.2	86.2	86.2	86.2	86.2	86.2	86.2	79.2	
23.0	84.5	84.5	84.5	84.5	84.5	84.5	84.5	84.5	84.5	77.5	
24.0	83.2	83.2	83.2	83.2	83.2	83.2	83.2	83.2	83.2	76.2	

Example (Building Enclosure)

	Brick Walls								
	Brick, 8 in. LW CMU, R-22 Batt Insulation, Gyp. Board	Brick, R-5 Insulation Board, 8 in. HW CMU, Gyp. Board	Brick, R-10 Insulation Board, 8 in. HW CMU, Gyp. Board	Brick, R-5 Insulation Board, Brick	Brick, R-10 Insulation Board, Brick	Brick, R-5 Insulation Board, 8 in. LW Concrete, Gyp. Board	Brick, R-10 Insulation Board, 8 in. LW Concrete, Gyp. Board	Brick, R-5 Insulation Board, 12 in. HW Concrete, Gyp. Board	Brick, R-10 Insulation Board, 12 in. HW Concrete, Gyp. Board
Wall Number	30	31	32	33	34	35	36	37	38
<i>U</i>, Btu/h·ft²·°F	0.036	0.111	0.071	0.124	0.077	0.091	0.062	0.097	0.062
Total <i>R</i>	27.4	9.0	14.0	8.1	13.0	11.0	16.0	10.3	16.0
Hour	Conduction Time Factors, %								
0	1.9	1.8	2.0	0.9	1.0	3.3	3.4	3.8	3.9
1	1.8	1.7	1.9	1.3	1.2	3.1	3.3	3.8	3.8
2	1.8	2.4	2.3	3.3	2.8	3.0	3.2	3.7	3.8
3	2.7	3.8	3.4	5.8	5.0	3.1	3.2	3.7	3.8
4	4.0	5.1	4.6	7.3	6.6	3.4	3.4	3.8	3.8
5	5.4	6.0	5.5	8.0	7.5	3.8	3.7	3.9	3.9
6	6.2	6.5	6.1	8.2	7.8	4.2	4.1	4.1	4.0
7	6.7	6.6	6.3	7.9	7.7	4.6	4.4	4.2	4.2
8	6.8	6.6	6.3	7.5	7.4	4.8	4.6	4.3	4.3
9	6.6	6.4	6.2	6.9	6.9	5.0	4.8	4.4	4.4
10	6.4	6.1	6.0	6.2	6.4	5.1	4.9	4.5	4.5
11	6.0	5.7	5.7	5.6	5.8	5.1	5.0	4.5	4.5
12	5.6	5.3	5.4	5.0	5.2	5.1	4.9	4.6	4.5
13	5.2	4.9	5.0	4.4	4.6	5.0	4.9	4.6	4.5
14	4.8	4.6	4.7	3.8	4.1	4.9	4.8	4.5	4.5
15	4.4	4.2	4.3	3.3	3.6	4.7	4.7	4.5	4.5
16	4.0	3.8	4.0	2.9	3.2	4.6	4.6	4.3	4.3
17	3.7	3.5	3.7	2.5	2.8	4.4	4.4	4.3	4.3
18	3.4	3.2	3.4	2.2	2.4	4.2	4.3	4.2	4.2
19	3.1	2.9	3.1	1.9	2.1	4.1	4.1	4.2	4.2
20	2.8	2.6	2.9	1.6	1.8	3.9	4.0	4.1	4.1
21	2.5	2.4	2.6	1.4	1.6	3.7	3.9	4.0	4.1
22	2.3	2.1	2.4	1.2	1.4	3.6	3.7	4.0	4.0
23	2.1	1.9	2.2	1.0	1.2	3.4	3.6	3.9	3.9
Total Percentage	100	100	100	100	100	100	100	100	100

Example (Building Enclosure)

- Write the cooling load equations:

$$Q_{cond,16} = Q_{cond,16,rad} + Q_{cond,16,conv}$$

$$Q_{cond,16,rad} = f_{rad} \times Q_{cond,16}$$

$$Q_{cond,16,conv} = f_{conv} \times Q_{cond,16}$$

Example (Building Enclosure)

- Write the cooling load equations:

$$Q_{cond,16,conv} = q_{cond,16}$$

$$Q_{cond,16,conv} = f_{conv} \times Q_{cond,16}$$

Example (Building Enclosure)

- Write the cooling load equations:

$$\begin{aligned} Q_{cond,16,rad} &= r_0 \times q_{cond,16,rad} + r_1 \times q_{cond,15,rad} \\ &+ r_2 \times q_{cond,14,rad} + r_3 \times q_{cond,13,rad} \\ &+ \dots + \dots + \dots + \dots \\ &+ r_{22} \times q_{cond,18,rad} + r_{23} \times q_{cond,17,rad} \end{aligned}$$

Example (Building Enclosure)

- Write the cooling load equations:

$$q_{\theta} = \sum_{j=0}^{23} c_j UA (t_{e,\theta-j\delta} - t_{rc})$$

$$\begin{aligned} q_{cond,16} = & UA [c_0 (t_{sol-air,16} - t_{setpoint}) + c_1 (t_{sol-air,15} - t_{setpoint}) \\ & + \dots + \dots + \dots \\ & + \dots c_{22} (t_{sol-air,18} - t_{setpoint}) + c_{23} (t_{sol-air,17} - t_{setpoint})] \end{aligned}$$

Example (Building Enclosure)

- Let's look at Problem 1 Part (c) of the shared exam solutions

Example (Building Enclosure)

- Write the cooling load equations:

$$q_{\theta} = \sum_{j=0}^{23} c_j UA (t_{e,\theta-j\delta} - t_{rc})$$


$$\begin{aligned} q_{cond,16} = & UA [c_0 (t_{sol-air,16} - t_{setpoint}) + c_1 (t_{sol-air,15} - t_{setpoint}) \\ & + \dots + \dots + \dots \\ & + \dots c_{22} (t_{sol-air,18} - t_{setpoint}) + c_{23} (t_{sol-air,17} - t_{setpoint})] \end{aligned}$$

SPREADSHEETS

Spreadsheets

Supplemental files for *Load Calculation Applications Manual*, Second Edition (I-P and SI Editions)

Thank you for purchasing *Load Calculation Applications Manual*, Second Edition. The zip file linked below provides access to Microsoft® Excel® spreadsheets for solar irradiation, conduction time factor series, and radiant time factors used in the method. The spreadsheets can be adapted to compute cooling loads for a wide range of window types, orientations, and materials. The spreadsheets are available for both the I-P and SI editions of the book.

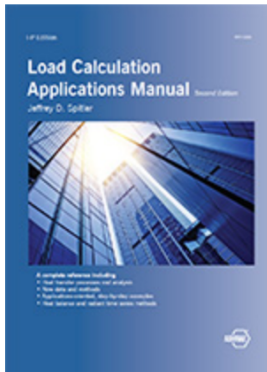

Load Calculation Applications Manual

The spreadsheets included are:

7-1-solar.xls
7-3_tabulated_CTSF.xls
7-4_generate_CSTF.xls
7-6 RTF_tabulated.xls

Example 7.1 Compute CTSF.xls
Example 7.1 Conduction.xls
Example 7.2 Window.xls
Example 7.3 RTF Generation.xls
Example 7.4 ClgLoad from heat gain.xls
Example 8.1 Compute CTSF.xls
Example 8.1 Compute RTF.xls
Example 8.1 solar.xls
Example 8.1 Conduction HG.xls

B-1_RTSM_IP.xls
B-1_RTSM_SI.xls
C-1_CTSFgen.xls
C-2_RTfgen.xls
D-1 solar.xls

[Supplemental Files](#)
(zip file, 226 MB)

Please right-click the link to download and save the zip file to your laptop or desktop computer. These files are available only to purchasers of this book; the files are not accessible, please contact the publisher.

Need a copy of the book? The latest edition is available for purchase in print or digital format in the ASHRAE Bookstore.

[Buy I-P Edition Now](#)

[Buy SI Edition Now](#)

Spreadsheets

Solar Irradiation & Sol-Air Temperature					
Latitude Angle	33.64				
Longitude Angle	84.43				
Site Name	USA - GA - ATLANTA MUNICIPAL				
Design Conditions	5%				
Facing Direction	0.0	45.0	90.0	135.0	180.0
Tilt Angle	0.0	90.0			
Time Zone	5	NAE			
DayLightSavings	1				
Months	1	2	3	4	5
DayOfMonth	21				
UnitsOfMeas	IP				
Peak Temperature	62.8	65.9	73.3	79.5	84.3
Daily Range	20.4	21.0	23.0	22.8	20.3
Taub	0.334	0.324	0.355	0.383	0.379
Taud	2.614	2.58	2.474	2.328	2.324

AE (www.ashrae.org). For personal use only. Additional reproduction, distribution, or transmiss

Local Time
 Solar Time
 SI
 IP

Location

Site Name:

Latitude: Design Conditions:

Longitude:

Hemisphere: North South

Time Zone: Of Greenwich Meridian: West East

Surface Parameters

Facing:

Tilt Angle:

Date

Month: Daylight Savings Time: Yes No

Day:

Solar Parameters

taub: taud: Ground Reflectance:

Sol-air Temperature Parameters

Design Temperature: °F Absorptance Out:

Daily Range: °F Surf. Conductance Out: Btu/hr-ft² °F

Spreadsheets

Solar Irradiation (Btu/hr-ft²) for January 21, 41.99°N Latitude, 87.91°W Longitude, Time Zone: NAC Standard Time										
USA - IL - CHICAGO/O'HARE ARPT, Ground Reflectance: rhog = 0.2										
Local Time	N	NE	E	SE	S	SW	W	NW	Horiz	
1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
7.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
8.0	5.7	31.3	120.1	142.4	84.1	5.9	5.7	5.7	22.5	
9.0	13.7	15.1	168.7	237.1	173.7	18.6	13.7	13.7	71.0	
10.0	19.9	19.9	149.5	264.1	235.0	80.9	19.9	19.9	113.5	
11.0	23.9	23.9	97.9	251.5	272.6	147.5	23.9	23.9	141.6	
12.0	25.3	25.3	30.8	211.6	286.0	206.7	27.4	25.3	151.9	
13.0	24.1	24.1	24.1	153.6	274.9	248.7	92.0	24.1	143.4	
14.0	20.4	20.4	20.4	87.3	239.6	264.3	145.7	20.4	116.8	
15.0	14.4	14.4	14.4	23.9	180.6	241.9	168.9	15.7	75.5	
16.0	6.5	6.5	6.5	6.8	94.3	156.0	129.7	31.8	26.9	
17.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
19.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
20.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
21.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
22.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
23.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
24.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	

Sol-Air Temperature (°F) for January 21, 41.99°N Latitude, 87.91°W Longitude, Time Zone: NAC Standard Time										
USA - IL - CHICAGO/O'HARE ARPT, 5% Design Condition, Surface Color: alpha/ho = 0.3										
Local Time	Air Temp.	N	NE	E	SE	S	SW	W	NW	Horiz
1.0	28.6	28.6	28.6	28.6	28.6	28.6	28.6	28.6	28.6	21.6
2.0	27.9	27.9	27.9	27.9	27.9	27.9	27.9	27.9	27.9	20.9
3.0	27.5	27.5	27.5	27.5	27.5	27.5	27.5	27.5	27.5	20.5
4.0	27.0	27.0	27.0	27.0	27.0	27.0	27.0	27.0	27.0	20.0
5.0	26.6	26.6	26.6	26.6	26.6	26.6	26.6	26.6	26.6	19.6
6.0	26.9	26.9	26.9	26.9	26.9	26.9	26.9	26.9	26.9	19.9
7.0	28.0	28.0	28.0	28.0	28.0	28.0	28.0	28.0	28.0	21.0
8.0	30.7	32.4	40.1	66.8	73.5	56.0	32.5	32.4	32.4	30.5
9.0	33.9	38.0	38.5	84.5	105.1	86.1	39.5	38.0	38.0	48.3
10.0	36.8	42.7	42.7	81.6	116.0	107.3	61.0	42.7	42.7	63.8
11.0	39.3	46.4	46.4	68.6	114.7	121.1	83.5	46.4	46.4	74.8
12.0	41.0	48.5	48.5	50.2	104.4	126.8	103.0	49.2	48.5	79.5
13.0	42.3	49.5	49.5	49.5	88.4	124.8	116.9	69.9	49.5	78.3
14.0	43.2	49.3	49.3	49.3	69.4	115.1	122.5	86.9	49.3	71.2
15.0	42.2	47.5	47.5	47.5	50.4	97.4	115.9	92.9	47.9	59.9

INPUT DATA	33.64°N84.43°W5	41.99°N87.91°W6	+
------------	-----------------	------------------------	---

OPENSTUDIO LOAD CALC

OpenStudio Load Calc

- How many of you finish the modeling?

OpenStudio Load Calc

- Read the results

The screenshot displays the OpenStudio Results Summary interface. At the top, there is a menu bar with 'File', 'Preferences', 'Components & Measures', and 'Help'. Below the menu bar, the title 'Results Summary' is visible. A dropdown menu labeled 'Reports:' is set to 'OpenStudio Results'. A vertical sidebar on the left contains various icons representing different report categories. The main content area is divided into two sections: a sidebar menu and two summary panels.

Results Summary

Reports: OpenStudio Results

OpenStudio Result Model Summary

Building Summary

Data
Building Name
Total Site Energy
Total Building Area
Total Site EUI
OpenStudio Standards Building Type

Weather Summary


Weather File
Latitude
Longitude
Elevation
Time Zone
North Axis Angle
ASHRAE Climate Zone

Sidebar Menu:

- Model Summary
- Annual Overview
- Monthly Overview
- Utility Bills/Rates
- Envelope Summary
- Space Type Breakdown
- Space Type Summary
- Interior Lighting Summary
- Plug Loads Summary
- Exterior Lighting
- Water Use Equipment
- HVAC Load Profiles
- Zone Conditions
- Zone Overview
- Zone Equipment Detail
- Air Loops Detail
- Plant Loops Detail
- Outdoor Air
- Cash Flow
- Site and Source Summary
- Schedule Overview

OpenStudio Load Calc

- Read the results



- Space Type Summary
- Interior Lighting Summary
- Plug Loads Summary
- Exterior Lighting
- Water Use Equipment
- HVAC Load Profiles
- Zone Conditions
- Zone Overview**
- Zone Equipment Detail
- Air Loops Detail
- Plant Loops Detail
- Outdoor Air
- Cash Flow
- Site and Source Summary
- Schedule Overview

ZONE 317	1225.04	Yes	Yes	16537.51	1.00	999.0	0.0	649.39	0.98
Total	64528.03			876636.11		23651.97	8990.99	14298.67	1.0
Conditioned Total	64528.03			876636.11		23651.97	8990.99	14298.67	1.0
Unconditioned Total	0.0			0.0		0.0	0.0	0.0	0.0
Not Part of Total	0.0			0.0		0.0	0.0	0.0	0.0

Zone Sensible Cooling and Heating Sensible Sizing

	Heating/Cooling	Calculated Design Load	Design Load With Sizing Factor	Calculated Design Air Flow (ft ³ /min)	Design Air Flow With Sizing Factor (ft ³ /min)	Date/Time Of Peak	Outdoor Temperature at Peak Load (F)
FPB 1-1 & VAV 1-1/2	Cooling	5.74 (ton)	6.6 (ton)	3570.31	4104.27	7/21 15:00:00	88.16
FPB 1-1 & VAV 1-1/2	Heating	19.03 (kBtu/h)	23.79 (kBtu/h)	519.13	2782.09	1/21 06:00:00	-0.04
FPB 1-2/3	Cooling	4.48 (ton)	5.15 (ton)	2779.97	3197.39	7/21 16:40:00	86.38
FPB 1-2/3	Heating	95.53 (kBtu/h)	119.41 (kBtu/h)	2601.98	3252.48	1/21 04:00:00	-0.04
FPB 1-4	Cooling	0.63 (ton)	0.72 (ton)	391.99	449.2	7/21 08:50:00	79.05
FPB 1-4	Heating	9.0 (kBtu/h)	11.25 (kBtu/h)	245.79	307.24	1/21 06:00:00	-0.04
FPB 1-5	Cooling	0.73 (ton)	0.84 (ton)	451.32	519.13	7/21 08:50:00	79.05
FPB 1-5	Heating	10.86 (kBtu/h)	13.57 (kBtu/h)	296.64	370.8	1/21 04:00:00	-0.04
VAV 1-10/11	Cooling	1.66 (ton)	1.91 (ton)	1036.13	1190.81	7/21 09:30:00	80.87
VAV 1-10/11	Heating	9.94 (kBtu/h)	12.42 (kBtu/h)	271.22	408.94	1/21 06:00:00	-0.04

OpenStudio Load Calc

- Read the results

The screenshot displays the OpenStudio interface with the 'Results Summary' window open. The main window shows simulation details for 'Wishnick Hall' and a table of energy data. A smaller window in the foreground shows a 'Table of Contents' for the results.

Program Version: EnergyPlus, Version 22.1.0-ed759b17ee, YMD=2023.02.09 07:54
Tabular Output Report in Format: HTML
Building: Wishnick Hall
Environment: RUN PERIOD 1 ** Chicago Ohare Intl Ap IL USA TMY3 WMO#=725300
Simulation Timestamp: 2023-02-09 07:54:36

Report: Annual Building Utility Performance Summary
For: Entire Facility
Timestamp: 2023-02-09 07:54:36
Values gathered over 8760.00 hours

Site and Source Energy

	Total Energy [GJ]	Energy Per Total Building Area [MJ/m2]	Energy Per Conditioned Building Area [MJ/m2]
Total Site Energy	7516.71	1253.86	1253.86
Net Site Energy	7516.71	1253.86	1253.86
Total Source Energy	22321.65	3723.47	3723.47
Net Source Energy	22321.65	3723.47	3723.47

Table of Contents

- [Top](#)
- [Annual Building Utility Performance Summary](#)
- [Input Verification and Results Summary](#)
- [Demand End Use Components Summary](#)
- [Source Energy End Use Components Summary](#)
- [Component Sizing Summary](#)
- [Surface Shadowing Summary](#)
- [Adaptive Comfort Summary](#)
- [Initialization Summary](#)
- [Annual Heat Emissions Summary](#)
- [Climatic Data Summary](#)
- [Envelope Summary](#)
- [Shading Summary](#)
- [Lighting Summary](#)
- [Equipment Summary](#)
- [HVAC Sizing Summary](#)
- [Coil Sizing Details](#)
- [System Summary](#)
- [Outdoor Air Summary](#)
- [Outdoor Air Details](#)
- [Object Count Summary](#)
- [Energy Meters](#)
- [Sensible Heat Gain Summary](#)
- [Standard 62.1 Summary](#)
- [LEED Summary](#)
- [Annual Thermal Resilience Summary](#)
- [Annual CO2 Resilience Summary](#)
- [Annual Visual Resilience Summary](#)

BUILDING ENERGY PERFORMANCE - ELECTRICITY

| Meter |

OpenStudio Load Calc

- Read the results

Project 2j RPD down.osm

File Preferences Components & Measures Help

Results Summary

Reports: EnergyPlus Results Refresh Set Path to DView in Preferences

Report: HVAC Sizing Summary [Table of Contents](#)

For: Entire Facility

Timestamp: 2023-02-09 07:52:16

Zone Sensible Cooling

	Calculated Design Load [W]	User Design Load [W]	User Design Load per Area [W/m2]	Calculated Design Air Flow [m3/s]	User Design Air Flow [m3/s]	Design Day Name	Date/Time Of Peak {TIMESTAMP}	Thermostat Setpoint Temperature at Peak Load [C]	Indoor Temperature at Peak Load [C]	Indoor Humidity Ratio at Peak Load [kgWater/kgDryAir]	Outdoor Temperature at Peak Load [C]	Outdoor Humidity Ratio at Peak Load [kgWater/kgDryAir]	Minimum Outdoor Air Flow Rate [m3/s]	Heat Gain Rate from DOAS [W]
FPB 1-1 & VAV 1-1/2	20175.78	23202.14	52.20	1.685	1.937	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 15:00:00	24.00	23.98	0.01373	31.20	0.01864	1.313	0.00
FPB 1-2/3	15743.33	18104.83	57.52	1.312	1.509	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 16:40:00	24.00	24.00	0.00936	30.21	0.01863	0.080	0.00
FPB 1-4	2214.67	2546.87	55.95	0.185	0.212	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 08:50:00	24.00	24.00	0.00929	26.14	0.01863	0.012	0.00
FPB 1-5	2558.68	2942.48	42.01	0.213	0.245	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 08:50:00	24.00	24.00	0.00946	26.14	0.01863	0.018	0.00
VAV 1-10/11	5850.87	6728.50	104.96	0.489	0.562	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 09:30:00	24.00	23.98	0.01189	27.15	0.01863	0.193	0.00
VAV 1-12	5874.39	6755.55	107.73	0.490	0.564	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 09:20:00	24.00	23.98	0.01182	26.91	0.01863	0.189	0.00
VAV 1-13	461.00	530.15	29.72	0.038	0.044	CHICAGO.MIDWAY.INTL.AP ANN CLG .4% CONDNS ENTH=>MDB	7/21 15:50:00	24.00	24.00	0.01066	30.77	0.01863	0.009	0.00